

Safety instructions

VEGADIF 85

Intrinsic safety

Two-wire 4 ... 20 mA

Two-wire 4 ... 20 mA/HART (with SIL qualification)

Profibus PA

Foundation Fieldbus



Document ID: 55213



VEGA

Contents

1	Area of applicability.....	3
2	Important specification in the type code.....	3
3	Different ignition protection types	4
4	General information.....	5
5	Application area.....	5
6	Specific conditions of use ("X" identification)	6
7	Important information for mounting and maintenance.....	6
8	Safe operating mode	8
9	Potential equalization/Grounding	8
10	Instructions for zone 0, zone 0/1 applications	9
11	Electrical data.....	9
12	Thermal data	12

Supplementary documentation:

- Operating Instructions VEGADIF 85
- Certificate of Conformity IECEX TUN 16.0036 X (Document ID: 55214)

Editing status: 2020-09-09

1 Area of applicability

These safety instructions apply to the differential pressure transmitters VEGADIF 85 of type series:

- VEGADIF DF85.*\VC/U/O/H*****Z/H/A/P/F*****

with the electronics versions

- Z - Two-wire 4 ... 20 mA
- H - Two-wire 4 ... 20 mA/HART
- A - Two-wire 4 ... 20 mA/HART with SIL qualification
- P - Profibus PA
- F - Foundation Fieldbus

According to Certificate of Conformity IECEx TUN 16.0036 X (certificate number on the type label) and for all instruments with safety instruction 55213.

The classification as well as the respective standards are stated in the Certificate of Conformity:

- IEC 60079-0: 2017
- IEC 60079-11: 2011
- IEC 60079-26: 2014

Type of protection marking:

- Ex ia IIC T6 ... T1 Ga
- Ex ia IIC T6 ... T1 Ga/Gb
- Ex ia IIC T6 ... T1 Gb

2 Important specification in the type code

VEGADIF DF85(*).ab**e**hijk*m*


Position		Feature	Description
a	Scope	A	ATEX / Europe
		V	Combination (ATEX, IECEx, FM, CSA)
b	Approval	C	IEC Ex ia IIC T6 ... T1
		U	IEC Ex ia IIC T6 ... T1 + Overfill protection (WHG, VLAREM)
		O	IEC Ex ia IIC T6 ... T1 + Ship approval
		H	IEC Ex ia IIC T6 ... T1 + Ex ta T...°C IP 66
e	Seal	A	FKM (ERIKS 514531)
		C	PTFE
		H	Copper seal
		Z	EPDM (ERIKS 55914)
		*	Further sealings
h	Electronics	Z	Two-wire 4 ... 20 mA
		H	Two-wire 4 ... 20 mA/HART
		A	Two-wire 4 ... 20 mA/HART with SIL qualification
		P	Two-wire Profibus PA
		F	Two-wire Foundation Fieldbus

Position		Feature	Description
i	Supplementary electronics	X	without
		Z	Additional current output 4 ... 20 mA
j	Housing	K	Plastic single chamber
		A	Aluminium - single chamber
		D	Aluminium - double chamber
		V	Stainless steel single chamber (precision casting)
		8	Stainless steel single chamber (electropolished)
		W	Stainless steel double chamber housing (precision casting)
		R	Stainless steel double chamber (electropolished)
		*	Further housings with special colour
k	Housing version / Protection	I	compact / IP66/IP67; NEMA 4X
		D	compact / IP66/IP68 (0,2 bar); NEMA 6P
		N	compact / IP66/IP68 (1 bar); NEMA 6P
		M	compact / IP69K
		A	axial cable outlet IP68 (PUR) with external housing / IP66/IP67; NEMA 4X
		S	lateral cable outlet IP68 (PUR) with external housing / IP66/IP67; NEMA 4X
		K	axial cable outlet IP68 (PE) with external housing / IP66/IP67; NEMA 4X
		L	lateral cable outlet IP68 (PE) with external housing / IP66/IP67; NEMA 4X
m	Display and adjustment module PLICSCOM	X	without
		A	mounted
		F	without; lid with inspection window
		B	Laterally mounted
		K	mounted; with Bluetooth, magnetic pen operation
		L	laterally mounted; with Bluetooth, magnetic pen operation

3 Different ignition protection types

The VEGADIF 85 can be either used in explosive dust atmospheres or in explosive gas atmospheres.

The operator must specify the selected ignition protection type before installation. The selected ignition protection must be determined by marking it firmly on the identification label of the type plate.

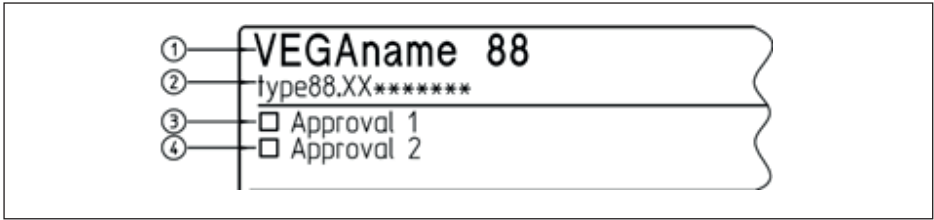

- 1 VEGADIF 85
- 2 Instrument version
- 3 Identification label: Approval in dust ignition protection type e. g. „Ex t“
- 4 Identification label: Approval in Gas ignition protection type e. g. „Ex i“, „Ex d“

If VEGADIF 85 is installed in a dust atmosphere, then the safety instructions and the instructions in the respective certificates must be noted:

Installation	Approval	Certificate	Safety instruction
Dust	"IH"	IECEX TUN 17.0007X	55628

4 General information

VEGADIF 85 is a differential pressure transmitter for measurement of differential pressure, flow, level, density and interface.

It consists of a differential pressure measuring cell and an electronics housing which is optionally also executed as external housing.

The display and adjustment module PLICSCOM can be mounted optionally.

The VEGADIF 85 are suitable for applications in hazardous atmospheres of all combustible materials of explosion groups IIA, IIB and IIC.

The VEGADIF 85 are suitable for applications requiring EPL Ga, EPL Ga/Gb or EPL Gb instruments.

5 Application area

EPL Ga instrument








The VEGADIF 85 with the mechanical fixing element are installed in hazardous areas of zone 0 requiring EPL Ga instruments.

EPL Ga/Gb or EPL Ga/Gc instrument

The VEGADIF 85 with mechanical fixing element are installed in hazardous areas of zone 1 or zone 2 requiring EPL Gb or EPL Gc instruments. The mechanical fixing element, process connection element is installed in the separating wall, which separates areas requiring EPL Gb or EPL Gc instruments. The sensor measuring system is installed in hazardous areas of zone 0 requiring EPL Ga instruments.

EPL Gb instrument

The VEGADIF 85 with the mechanical fixing element are installed in hazardous areas of zone 1 requiring EPL Gb instruments.

VEGA Instrument	EPL Gc	EPL Gb	EPL Ga/Gb	EPL Ga
Ex Zone 2 				
Ex Zone 1 				
Ex Zone 0 				

6 Specific conditions of use ("X" identification)

The following overview is listing all special properties of VEGADIF 85, which make a labelling with the symbol "X" behind the certificate number necessary.

Electrostatic charging (ESD)

You can find the details in chapter " *Electrostatic charging (ESD)*" of these safety instructions.

Ambient temperature

You can find the details in chapter " *Thermal data*" of these safety instructions.

Impact and friction sparks

The VEGADIF 85 in light metal versions (e.g. aluminium, titanium, zircon) must be mounted in such a way that sparks from impact and friction between light metals and steel (except stainless steel, if the presence of rust particles can be excluded) cannot occur.

Non-grounded, metallic parts

The resistance between aluminium housing to metal measuring point identification plate is $> 10^9$ Ohm.

The capacitance of the metal measuring point identification plate was measured with 15 pF.

For versions with external housing

For the version with external housing, the potential equalization must be provided in the complete range of the connection cable between electronics housing and transmitter housing.

Make sure that the coaxial connection cable between electronics housing and sensor housing cannot get damaged.

7 Important information for mounting and maintenance

General instructions

The following requirements must be fulfilled for mounting, electrical installation, setup and maintenance of the instrument:

- The staff must be qualified according the respective tasks
- The staff must be trained in explosion protection

- The staff must be familiar with the respectively valid regulations, e.g. planning and installation acc. to IEC 60079-14
- Make sure when working on the instrument (mounting, installation, maintenance) that there is no explosive atmosphere present, the supply circuits should be voltage-free, if possible.
- The instrument has to be mounted according to the manufacturer specifications, the Certificate of Conformity and the valid regulations and standards
- Modifications on the instrument can influence the explosion protection and hence the safety, therefore repairs are not permitted to be conducted by the end user
- Modifications must only be carried out by employees authorized by VEGA company
- Use only approved spare parts
- Components for installation and connection not included in the approval documents are only permitted if these correspond technically to the latest standard mentioned on the cover sheet. They must be suitable for the application conditions and have a separate certificate. The special conditions of the components must be noted and if necessary, the components must be integrated in the type test. This applies also to the components already mentioned in the technical description.
- Vessel installations and probable flow must be taken into account

Cable and wire entries

- The VEGADIF 85 must be connected via suitable cable gland or conduit systems that are in conformity with the requirements of the flame proofing and the IP protection and provided with a separate type approval certificate. When connecting VEGADIF 85 to conduit systems, the corresponding sealing facility must be connected directly to the housing.
- The red thread or/dust covers screwed in when the instruments are shipped (depending on the version) must be removed before setup and replaced by cable entries or closing screws suitable for the respective ignition protection type and IP protection.
- Note type and size of the thread: A label with the respective thread name is in the area of the respective thread
- Threads must have no damages
- Cable entries and closing screws should be mounted correctly and according to the safety instructions of the manufacturer to ensure the specified ignition protection type and IP protection rating. When using certified or suitable cable glands, closing screws or plug connections, it is absolutely necessary to note the corresponding certificates/documents. Supplied cable entries or closing screws meet these requirements.
- Unused openings must be closed with plugs suitable for the ignition protection type and IP protection. Supplied plugs meet these requirements.
- Cable or wire entries resp. the closing screws must be tightly screwed into the housing
- The connection cables resp. pipeline sealing facilities must be suitable for the application conditions (e.g. temperature range) of the application
- With surface temperatures > 70 °C, the cables must be suitable for the higher application conditions
- The connection cable of VEGADIF 85 has to be wired fix and in such a way that damages can be excluded.

Mounting

Keep in mind for instrument mounting

- Mechanical damage on the instrument must be avoided
- Mechanical friction must be avoided
- Process connections separating two areas of different Ex-zones must comply to valid regulations and standards and the protection rating must be in conformity to IEC/EN 60529
- Close the housing lid (s) up to the stop before starting operating, to ensure the IP protection rating specified on the type label

Maintenance

To ensure the functionality of the device, periodic visual inspection is recommended for:

- Secure mounting
- No mechanical damages or corrosion
- Worn or otherwise damaged cables
- No loose connections of the line connections, equipotential bonding connections
- Correct and clearly marked cable connections

The parts of the VEGADIF 85 being in contact with flammable media during operation must be included in the periodic overpressure test of the plant.

Intrinsic safety "i"

- Valid regulations for connection of intrinsically safe circuits, e.g. proof of intrinsic safety according to IEC/EN 60079-14 must be observed
- The instrument is only suitable for connection to certified, intrinsically safe instruments
- When connecting a circuit with protection level Ex ib, the device, the sensor meas. system of the device must no more be used in hazardous areas of zone 0.
- When connecting an intrinsically safe instruments with classification mark Ex ia to a circuit with protection level Ex ib, then the classification mark of the instrument changes to Ex ib. After the use as instrument with Ex ib power supply, the instrument must no more be used in circuits with protection level Ex ia
- When connecting an intrinsically safe instrument to an non-intrinsically safe circuit, the instrument must be no longer used in intrinsically safe circuits
- With surface temperatures > 70 °C, the cables must be suitable for the higher application conditions

Version with exchangeable cable or rod probe

Only original VEGA cable or rod probes must be mounted to VEGADIF 85. When mounting cable or rod probes, the torques specified in the respective operating instruction manuals must be maintained. The mechanical connection must be ensured.

8 Safe operating mode

General operating conditions

- Do not operate the instrument outside the electrical, thermal and mechanical specifications of the manufacturer
- Use the instrument only in media against which the wetted parts are sufficiently resistant
- Note the relation between process temperature on the sensor/antenna and the permissible ambient temperature on the electronics housing. For permissible temperatures, see the respective temperature tables. See chapter " *Thermal data*".
- If necessary, a suitable overvoltage arrester can be connected in front of the VEGADIF 85
- For assessment and reduction of the explosion risk, valid standards such as for example ISO/EN 1127-1 must be taken into account

9 Potential equalization/Grounding

- Integrate the instruments into the local potential equalisation, e.g. via the internal or external earth terminal
- The potential equalization terminal must be secured against loosening and twisting
- If grounding of the cable screening is necessary, this must be carried out acc. to the valid standards and regulations, e.g. acc. to IEC/EN 60079-14
- The intrinsically safe input and the intrinsically safe output circuits are ground-free. The voltage resistance against ground is min. 500 Veff.

10 Instructions for zone 0, zone 0/1 applications

The usual atmospheric conditions (in accordance with IEC 60079-0 related to the properties of the explosive atmosphere) under which it is assumed that the measuring probe is operated in zone 0, are:

- Temperature: -20 ... +60 °C.
- Pressure: 80 ... 110 kPa (0.8 ... 1.1 bar)
- Air with normal oxygen content, normally 21 % (V/V)

The chapter " *Thermal Data*" contains concrete notes on the use outside of this usual temperature range.

If there are no explosive mixtures or supplementary measures, e.g. according to IEC 1127-1, then the instruments can be also operated according to the manufacturer specification outside atmospheric conditions.

The intrinsically safe supply/signal circuit must correspond to protective level Ex ia (EPL Ga).

Preferred are associated instrument with galvanic separation between intrinsically safe and non-intrinsically safe circuits.

If there is a risk of dangerous potential differences inside zone 0, then suitable measures for intrinsically safe circuits in zone 0 must be taken, e.g. according to the requirements of IEC 60079-14 section 16.3 (edition November 2014).

Instruments/sensors in the version where light metal, aluminium, magnesium, Titanium or zirconium is used, must be installed in such a way that the generation of sparks due to strokes or frictions can be excluded.

On the process fitting, a tightness acc. to protection IP67 following IEC 60529 must be ensured.

11 Electrical data

Supply and signal circuit

Intrinsically safe power supply and signal circuit: (terminals 1, 2) In type of protection intrinsic safety Ex ia IIC

Electronics Z/H/A:

Maximum values

$$U_i = 30 \text{ V}$$

$$I_i = 131 \text{ mA}$$

$$P_i = 983 \text{ mW}$$

$$L_i = 5 \text{ } \mu\text{H}$$

$$L_i = 10 \text{ } \mu\text{H (with connected electronics PLICSZEKX)}$$

$$C_i = \text{negligibly small}$$

In the version with fix connected connection cable the following values must be also taken into consideration:

$$L_i = 0.62 \text{ } \mu\text{H/m}$$

$$C_{i \text{ wire/wire}} = 150 \text{ pF/m}$$

$$C_{i \text{ wire/screen}} = 270 \text{ pF/m}$$

Electronics P/F:

Maximum values

$$U_i = 17.5 \text{ V}$$

$$I_i = 500 \text{ mA}$$

$$P_i = 5.5 \text{ W}$$

L_i = negligibly small (single chamber housing)

L_i = 5 μH (double chamber housing)

C_i = negligibly small

The instrument is suitable for connection to a Fieldbus system according to the FISCO model (IEC 60079-11), e.g. Profibus PA.

$$U_i = 24 \text{ V}$$

$$I_i = 250 \text{ mA}$$

$$P_i = 1.2 \text{ W}$$

In the version with fix connected connection cable the following values must be also taken into consideration:

$$L_i = 0.62 \mu\text{H/m}$$

$$C_{i \text{ wire/wire}} = 150 \text{ pF/m}$$

$$C_{i \text{ wire/screen}} = 270 \text{ pF/m}$$

Supply and signal current circuit when installing in a double chamber housing and the supplementary electronics PLICSZEZSA (2. current output)

Intrinsically safe power supply and signal circuit I: (terminals 1[+], 2[-]) In type of protection intrinsic safety Ex ia IIC

Electronics H/A:

Maximum values

$$U_i = 30 \text{ V}$$

$$I_i = 131 \text{ mA}$$

$$P_i = 983 \text{ mW}$$

$$L_i = 5 \mu\text{H}$$

C_i = negligibly small

In the version with fix connected connection cable the following values must be also taken into consideration:

$$L_i = 0.62 \mu\text{H/m}$$

$$C_{i \text{ wire/wire}} = 150 \text{ pF/m}$$

$$C_{i \text{ wire/screen}} = 270 \text{ pF/m}$$

Intrinsically safe power supply and signal circuit II: (terminals 7[+], 8[-]) In type of protection intrinsic safety Ex ia IIC

Electronics H/A:

Maximum values

$$U_i = 30 \text{ V}$$

$$I_i = 131 \text{ mA}$$

$$P_i = 983 \text{ mW}$$

$$L_i = 5 \text{ } \mu\text{H}$$

C_i = negligibly small

In the version with fix connected connection cable the following values must be also taken into consideration:

$$L_i = 0.62 \text{ } \mu\text{H/m}$$

$$C_{i \text{ wire/wire}} = 150 \text{ pF/m}$$

$$C_{i \text{ wire/screen}} = 270 \text{ pF/m}$$

Intrinsically safe display and adjustment circuit

Intrinsically safe display and adjustment circuit: (terminals 5, 6, 7, 8)

In type of protection intrinsic safety Ex ia IIC

For connection to the intrinsically safe circuit of the associated external indicating instrument VEGADIS 61/81 (IECEX PTB 06.0048).

The rules for connecting intrinsically safe circuits between VEGADIF 85 and the external display unit VEGADIS 61/81 are maintained if the following characteristic values are taken into consideration:

Electronics Z/H/A:

$$L_o = 330 \text{ } \mu\text{H}$$

$$C_o = 1.98 \text{ } \mu\text{F}$$

Electronics P/F:

$$L_o = 212 \text{ } \mu\text{H}$$

$$C_o = 1.98 \text{ } \mu\text{F}$$

L_i and C_i of the external display unit VEGADIS 61/81 are negligibly small.

When using the connection cable supplied by VEGA, the following values must be taken into consideration:

$$L_i = 0.62 \text{ } \mu\text{H/m}$$

$$C_{i \text{ wire/wire}} = 150 \text{ pF/m}$$

$$C_{i \text{ wire/screen}} = 270 \text{ pF/m}$$

Intrinsically safe circuit of the display and adjustment module

Circuit of the display and adjustment module: (spring contacts in the electronics compartment or connection compartment)

In type of protection intrinsic safety Ex ia IIC

For connection to the display and adjustment module PLICSCOM or VEGACONNECT.

The metallic parts of VEGADIF 85 are electrically connected with the earth terminals.

The intrinsically safe supply and signal circuits are galvanically separated from parts that can be grounded.

For applications requiring instruments of EPL Gb, the intrinsically safe power supply and signal circuit can correspond to protection class ia or ib. For connection to a circuit with protection class ib, the ignition protection type identification is Ex ib IIC T6 Gb.

For applications requiring instruments of type EPL Ga or EPL Ga/Gb, the intrinsically safe power supply and signal circuit must correspond to protection class ia.

For applications requiring EPL Ga resp. EPL Ga/Gb instruments the VEGADIF 85 is preferably connected to appropriate instruments with electrically isolated, intrinsically safe circuits.

12 Thermal data

The following temperature table applies to all housing and electronic versions and when using the instruments acc. to instrument category EPL Ga, EPL Ga/Gb, EPL Gb.

Temperature class	Product temperature (Tp) on the sensor	Ambient temperature (Ta)
T6 (+85 °C)	-40 ... +46 °C	-40 ... +46 °C
T5 (+100 °C)		
T4 (+135 °C)	-40 ... +85 °C	-40 ... +80 °C
T3 (+200 °C)		
T2 (+300 °C)		
T1 (+450 °C)		

The limits of the permissible temperature range can be limited due to the O-ring material used. The O-ring material used is specified on the type label. The limits for the temperature range depending on the materials are specified in the below table:


Name: Seal ring	Temperature range: Measuring cell	Temperature range: Seal ring
FKM	-40 ... +85 °C	-40 ... +220 °C
NBR	-20 ... +85 °C	-20 ... +120 °C
EPDM	-40 ... +85 °C	-50 ... +140 °C
PTFE	-40 ... +85 °C	-200 ... +260 °C
FFKM	-40 ... +85 °C	-46 ... +240 °C
Copper	-40 ... +85 °C	-200 ... +300 °C


In explosive steam-air mixtures, the instrument should only operated under atmospheric conditions:

- Temperature: -20 ... +60 °C.
- Pressure: 80 ... 110 kPa (0.8 ... 1.1 bar)
- Air with normal oxygen content, normally 21 %

If there is no explosive atmosphere, the permissible operating temperatures and pressures must be taken from the manufacturer specifications (operating instructions).



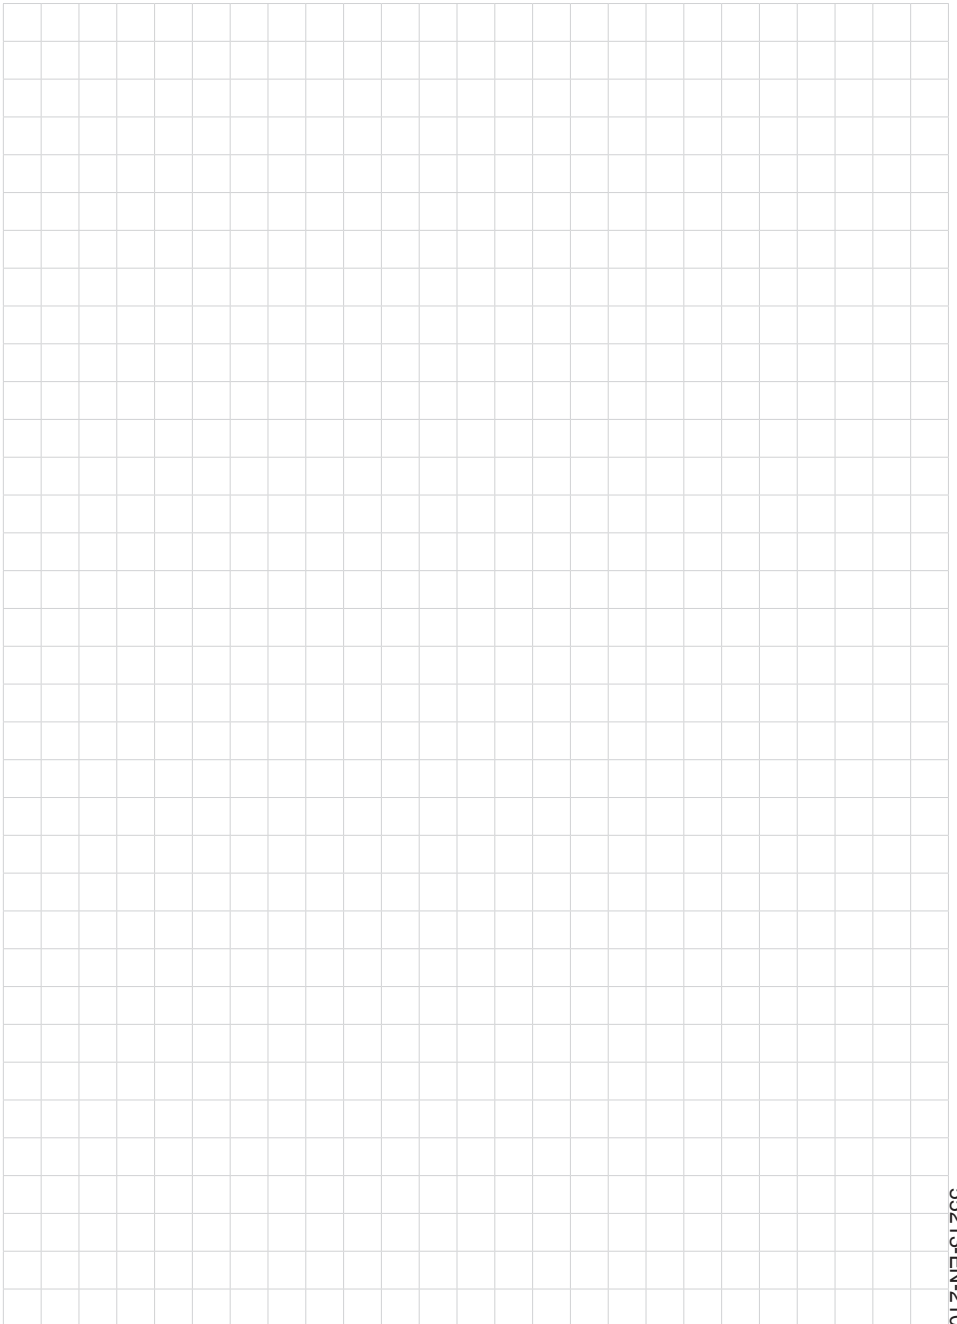

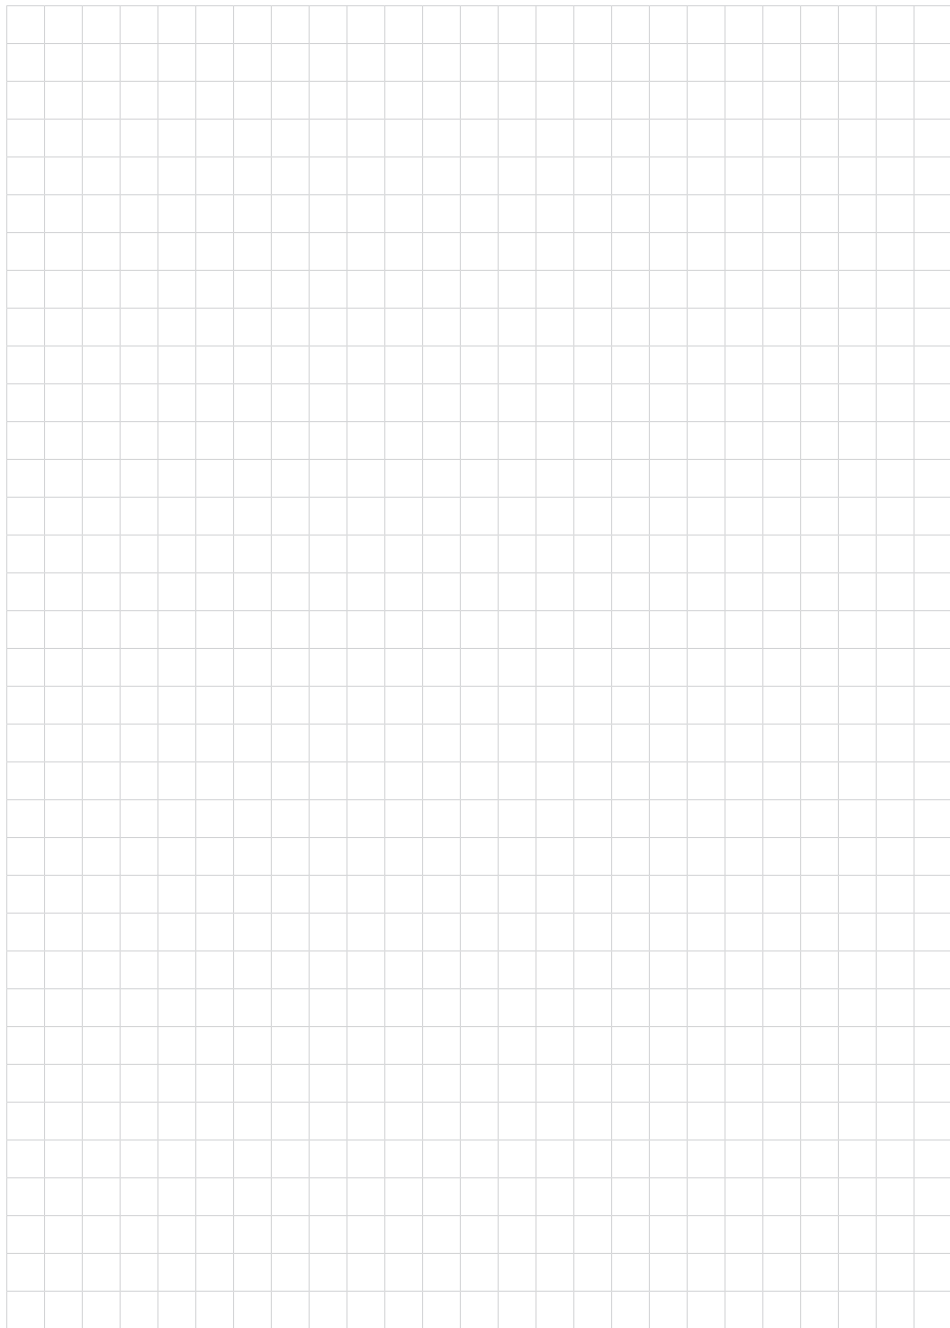

Printing date:

VEGA

All statements concerning scope of delivery, application, practical use and operating conditions of the sensors and processing systems correspond to the information available at the time of printing.

Subject to change without prior notice

© VEGA Grieshaber KG, Schiltach/Germany 2021

55213-EN-210323

VEGA Grieshaber KG
Am Hohenstein 113
77761 Schiltach
Germany

Phone +49 7836 50-0
E-mail: info.de@vega.com
www.vega.com