

## Safety instructions

### CCOE approval

### VEGAPULS 61, 62, 63, 65, 66, 68, SR68

Intrinsic safety

Profibus PA

Foundation Fieldbus

HW  $\geq$  2.0.0 - SW  $\geq$  4.0.0



Document ID: 62515



# VEGA

## Contents

<b>1</b>	<b>Area of applicability.....</b>	<b>3</b>
<b>2</b>	<b>General information.....</b>	<b>3</b>
<b>3</b>	<b>Important specification in the type code.....</b>	<b>4</b>
<b>4</b>	<b>Technical data .....</b>	<b>13</b>
<b>5</b>	<b>Application conditions .....</b>	<b>14</b>
<b>6</b>	<b>Protection against static electricity .....</b>	<b>17</b>
<b>7</b>	<b>Use of an overvoltage arrester .....</b>	<b>17</b>
<b>8</b>	<b>Grounding.....</b>	<b>18</b>
<b>9</b>	<b>Impact and friction sparks .....</b>	<b>18</b>
<b>10</b>	<b>Material resistance .....</b>	<b>18</b>
<b>11</b>	<b>Mounting with external display unit VEGADIS 61/81.....</b>	<b>18</b>
<b>12</b>	<b>Removing and replacing the red threaded/dust cover .....</b>	<b>18</b>
<b>13</b>	<b>Versions with antenna extension .....</b>	<b>19</b>
<b>14</b>	<b>Installation with swivelling holder.....</b>	<b>19</b>
<b>15</b>	<b>Versions with rinsing connection.....</b>	<b>19</b>

Supplementary documentation:

- Operating Instructions VEGAPULS 61, 62, 63, 65, 66, 68, SR68
- Letter P553369/1-4 By Government of India (Document ID: 1021214)

Editing status: 2023-03-08

## 1 Area of applicability

These safety instructions apply to the radar sensor VEGAPULS 61, 62, 63, 65, 66, 68, SR68 according to Letter P553369/1-4 By Government of India (certificate number on the type label) and for all instruments with the number of the safety instruction (62515) on the type label.

- VEGAPULS PS61/62/63/65/66/68/SR68(\*).C\*\*\*\*P/F\*\*\*\*
- VEGAPULS PS61/62/63(\*).C\*\*\*\*K/L/P/F\*\*\*\*

## 2 General information

The level measuring instrument VEGAPULS 61, 62, 63, 65, 66, 68, SR68 is based on radar technology and is used to detect the distance between medium surface and sensor by means of high frequency electromagnetic waves in the GHz range. The electronics uses the running time of the signals reflected by the medium surface to calculate the distance to the medium surface.

The VEGAPULS 61, 62, 63, 65, 66, 68, SR68 consist of an electronics housing, a process connection element and a sensor (the antenna). As an option the display and adjustment module can also be integrated.

The measured products can also be combustible liquids, gases, mist or vapour.

The VEGAPULS 61, 62, 63, 65, 66, 68, SR68 are suitable for use in hazardous atmospheres of all combustible materials of explosion group IIA, IIB and IIC for applications requiring instruments of category 1G, category 1/2G or category 2G.

If the VEGAPULS 61, 62, 63, 65, 66, 68, SR68 are installed and operated in hazardous areas, the general Ex installation regulations EN 60079-14 as well as these safety instructions must be observed.

The operating instructions as well as the installation regulations or standards that apply for explosion protection of electrical systems must generally be observed.

The installation of explosion-endangered systems must always be carried out by qualified personnel.

### Category 1G instruments

The VEGAPULS 61, 62, 63, 65, 66, 68, SR68 are installed in hazardous areas requiring an instrument of category 1G.

### Category 1/2G instruments

The electronics housing is installed in hazardous areas requiring instruments of category 2G. The process connection element is installed in the separating wall, which separates areas requiring instruments of category 2G or 1G. The antenna system with the mechanical fixing element is installed in hazardous areas requiring instruments of category 1G.

### Category 2G instruments

The VEGAPULS 61, 62, 63, 65, 66, 68, SR68 are installed in hazardous areas requiring an instrument of category 2G.

### Type of protection marking:

II 1G, 1/2G, 2G Ex ia IIC T6 ... T1 Ga, Ga/Gb, Gb

### 3 Important specification in the type code

#### VEGAPULS PS61(\*).abcdefghij

Position		Feature	Description
ab	Approval	CX	II 1G, 1/2G, 2G Ex ia IIC T6 ... T1 Ga, Ga/Gb, Gb
		CA	II 1G, 1/2G, 2G Ex ia IIC T6 ... T1 Ga, Ga/Gb, Gb + WHG
		CM	II 1G, 1/2G, 2G Ex ia IIC T6 ... T1 Ga, Ga/Gb, Gb + Ship approval
c	Version / Material / Process temperature	A	with encapsulated horn antenna (ø 40 mm) / PVDF / -40 ... +80 °C
		B	with plastic horn antenna (ø 80 mm) / PP / -40 ... +80 °C
de	Process fitting / Material	**	Threaded connection, Clamp, flanges; two-digit alphanumeric code for metallic process fittings, industrial flanges according to ASME, BS, DIN, EN, GOST, HG/T, JIS and for other international, national or industrial standards, guidelines or standards with suitable pressure and temperature specifications
f	Electronics	P	Two-wire Profibus PA
		K	Two-wire Profibus PA with increased sensitivity
		F	Two-wire Foundation Fieldbus
		L	Two-wire Foundation Fieldbus with increased sensitivity
g	Housing / Protection	K	Plastic single chamber / IP66/IP67
		A	Aluminium single chamber / IP66/IP68 (0.2 bar)
		H	Special colour Aluminium single chamber / IP66/IP68 (0.2 bar)
		3	Aluminium single chamber / IP66/IP68 (1 bar)
		D	Aluminium double chamber / IP66/IP68 (0.2 bar)
		S	Special colour Aluminium double chamber / IP66/IP68 (0.2 bar)
		Y	Aluminium double chamber / IP66/IP67 with M12 x 1 for VEGADIS 61/81
		V	Stainless steel single chamber (precision casting) / IP66/IP68 (0.2 bar)
		5	Stainless steel single chamber (precision casting) / IP66/IP68 (1 bar)
		8	Stainless steel single chamber (electropolished) / IP66/IP68 (0.2 bar)
		W	Stainless steel double chamber / IP66/IP68 (0.2 bar)
		Q	Stainless steel double chamber / IP66/IP67 with M12 x 1 for VEGADIS 61/81
		R	Plastic double chamber / IP66/IP67
		X	Plastic double chamber / IP66/IP67 with M12 x 1 for VEGADIS 61/81
h	Cable entry / Cable gland, Plug connection	M	M20 x 1.5 / without
		N	½ NPT / without
		*	One-digit alphanumeric code for further suitable fittings, cable entries and closing screws.

Position		Feature	Description
i	Display and adjustment module PLICSCOM	X	without
		A	mounted
		F	without; lid with inspection window
		B	Laterally mounted
		K	mounted; with Bluetooth, magnetic pen operation
		L	laterally mounted; with Bluetooth, magnetic pen operation
		U	mounted; with Bluetooth, magnetic pen operation, battery
		S	laterally mounted; with Bluetooth, magnetic pen operation, battery
j	Additional equipment	X	without
		*	with equipment

## VEGAPULS PS62(\*).abcdefghijklmnopqrstuvwxyz

Position		Feature	Description
ab	Approval	CX	II 1G, 1/2G, 2G Ex ia IIC T6 ... T1 Ga, Ga/Gb, Gb
		CA	II 1G, 1/2G, 2G Ex ia IIC T6 ... T1 Ga, Ga/Gb, Gb + WHG
		CM	II 1G, 1/2G, 2G Ex ia IIC T6 ... T1 Ga, Ga/Gb, Gb + Ship approval
c	Version / Material / Process temperature	*	Horn antennas, standpipe, parabolic antenna; One-digit alphanumeric variable for metal antenna, standpipe with different metal materials and diameters
de	Process fitting / Material	**	Threaded connection, flanges, swivelling holder; two-digit alphanumeric code for metallic process fittings, industrial flanges according to ASME, BS, DIN, EN, GOST, HG/T, JIS and for other international, national or industrial standards, guidelines or standards with suitable pressure and temperature specifications
f	Seal / Process temperature	2	FKM (SHS FPM 70C3 GLT) and PTFE / -40 ... +130 °C
		Z	FKM (SHS FPM 70C3 GLT) and PTFE / -40 ... +100 °C
		3	FFKM (Kalrez 6375) and PTFE / -20 ... +130 °C
		4	FKM (SHS FPM 70C3 GLT) and PTFE / -40 ... +200 °C
		5	FFKM (Kalrez 6375) and PTFE / -20 ... +200 °C
		7	FFKM (Kalrez 6230) and PTFE (FDA) / -15 ... +130 °C
		9	FFKM (Kalrez 6230) and PTFE / -15 ... +200 °C
		B	FKM (SHS FPM 70C3 GLT) and PP / -40 ... +80 °C, max. 3 bar
		D	FFKM (Kalrez 6375) and PP / -15 ... +80 °C, max. 3 bar
		A	FKM (SHS FPM 70C3 GLT) and PEEK / -40 ... +200 °C
		E	FFKM (Kalrez 6230) and PEEK / -15 ... +250 °C
		F	FFKM (Kalrez 6375) and PEEK / -20 ... +250 °C
		H	Ceramic graphite / -196 ... +450 °C

Position		Feature	Description
g	Electronics	P	Two-wire Profibus PA
		K	Two-wire Profibus PA with increased sensitivity
		F	Two-wire Foundation Fieldbus
		L	Two-wire Foundation Fieldbus with increased sensitivity
h	Housing / Protection	K	Plastic single chamber / IP66/IP67
		A	Aluminium single chamber / IP66/IP68 (0.2 bar)
		H	Special colour Aluminium single chamber / IP66/IP68 (0.2 bar)
		3	Aluminium single chamber / IP66/IP68 (1 bar)
		D	Aluminium double chamber / IP66/IP68 (0.2 bar)
		S	Special colour Aluminium double chamber / IP66/IP68 (0.2 bar)
		Y	Aluminium double chamber / IP66/IP67 with M12 x 1 for VEGADIS 61/81
		V	Stainless steel single chamber (precision casting) / IP66/IP68 (0.2 bar)
		5	Stainless steel single chamber (precision casting) / IP66/IP68 (1 bar)
		8	Stainless steel single chamber (electropolished) / IP66/IP68 (0.2 bar)
		W	Stainless steel double chamber / IP66/IP68 (0.2 bar)
		Q	Stainless steel double chamber / IP66/IP67 with M12 x 1 for VEGADIS 61/81
		R	Plastic double chamber / IP66/IP67
i	Cable entry / Cable gland, Plug connection	X	Plastic double chamber / IP66/IP67 with M12 x 1 for VEGADIS 61/81
		M	M20 x 1.5 / without
		N	½ NPT / without
j	Display and adjustment module PLICSCOM	*	One-digit alphanumerical code for further suitable fittings, cable entries and closing screws.
		X	without
		A	mounted
		F	without; lid with inspection window
		B	Laterally mounted
		K	mounted; with Bluetooth, magnetic pen operation
		L	laterally mounted; with Bluetooth, magnetic pen operation
		U	mounted; with Bluetooth, magnetic pen operation, battery
		S	laterally mounted; with Bluetooth, magnetic pen operation, battery
k	Additional equipment	X	without
		V	Purging connection with reflux valve
		*	with equipment

## VEGAPULS PS63(\*).abcdefghijklmnopqrstuvwxyz

Position		Feature	Description
ab	Approval	CX	II 1G, 1/2G, 2G Ex ia IIC T6 ... T1 Ga, Ga/Gb, Gb
		CA	II 1G, 1/2G, 2G Ex ia IIC T6 ... T1 Ga, Ga/Gb, Gb + WHG
		CM	II 1G, 1/2G, 2G Ex ia IIC T6 ... T1 Ga, Ga/Gb, Gb + Ship approval
c	Version / Material	*	with encapsulated horn antenna; One-digit alphanumeric variable for hygienically encapsulated horn antenna with different hygienically materials
de	Process fitting / Material	**	Clamp, slotted nut, flanges; two-digit alphanumeric code for metallic process fittings, industrial flanges according to ASME, BS, DIN, EN, GOST, HG/T, JIS and for other international, national or industrial standards, guidelines or standards with suitable pressure and temperature specifications
f	Electronics	P	Two-wire Profibus PA
		K	Two-wire Profibus PA with increased sensitivity
		F	Two-wire Foundation Fieldbus
		L	Two-wire Foundation Fieldbus with increased sensitivity
g	Housing / Protection	K	Plastic single chamber / IP66/IP67
		A	Aluminium single chamber / IP66/IP68 (0.2 bar)
		H	Special colour Aluminium single chamber / IP66/IP68 (0.2 bar)
		3	Aluminium single chamber / IP66/IP68 (1 bar)
		D	Aluminium double chamber / IP66/IP68 (0.2 bar)
		S	Special colour Aluminium double chamber / IP66/IP68 (0.2 bar)
		Y	Aluminium double chamber / IP66/IP67 with M12 x 1 for VEGADIS 61/81
		V	Stainless steel single chamber (precision casting) / IP66/IP68 (0.2 bar)
		5	Stainless steel single chamber (precision casting) / IP66/IP68 (1 bar)
		8	Stainless steel single chamber (electropolished) / IP66/IP68 (0.2 bar)
		Z	Stainless steel single chamber (electropolished) / IP66/IP68 (0.2 bar) / IP69K
		W	Stainless steel double chamber / IP66/IP68 (0.2 bar)
		Q	Stainless steel double chamber / IP66/IP67 with M12 x 1 for VEGADIS 61/81
		R	Plastic double chamber / IP66/IP67
		X	Plastic double chamber / IP66/IP67 with M12 x 1 for VEGADIS 61/81
h	Cable entry / Cable gland, Plug connection	M	M20 x 1.5 / without
		N	½ NPT / without
		*	One-digit alphanumeric code for further suitable fittings, cable entries and closing screws.

Position		Feature	Description
i	Display and adjustment module PLICSCOM	X	without
		A	mounted
		F	without; lid with inspection window
		B	Laterally mounted
		K	mounted; with Bluetooth, magnetic pen operation
		L	laterally mounted; with Bluetooth, magnetic pen operation
		U	mounted; with Bluetooth, magnetic pen operation, battery
		S	laterally mounted; with Bluetooth, magnetic pen operation, battery
j	Additional equipment	X	without
		*	with equipment

**VEGAPULS PS65(\*).abcdefghij**

Position		Feature	Description
ab	Approval	CX	II 1G, 1/2G, 2G Ex ia IIC T6 ... T1 Ga, Ga/Gb, Gb
		CA	II 1G, 1/2G, 2G Ex ia IIC T6 ... T1 Ga, Ga/Gb, Gb + WHG
		CM	II 1G, 1/2G, 2G Ex ia IIC T6 ... T1 Ga, Ga/Gb, Gb + Ship approval
c	Version / Material / Process temperature	K	Rod antenna for socket length: 50 mm / PVDF and PTFE / -40 ... +130 °C
		L	Rod antenna for socket length: 100 mm / PTFE / -40 ... +130 / +150 °C
		M	Rod antenna for socket length: 250 mm / PTFE / -40 ... +130 / +150 °C
de	Process fitting / Material	**	Threaded connection, flanges, Clamp, bolting; two-digit alphanumeric code for metallic process fittings, industrial flanges according to ASME, BS, DIN, EN, GOST, HG/T, JIS and for other international, national or industrial standards, guidelines or standards with suitable pressure and temperature specifications
f	Electronics	P	Two-wire Profibus PA
		F	Two-wire Foundation Fieldbus



Position		Feature	Description
g	Housing / Protection	K	Plastic single chamber / IP66/IP67
		A	Aluminium single chamber / IP66/IP68 (0.2 bar)
		H	Special colour Aluminium single chamber / IP66/IP68 (0.2 bar)
		3	Aluminium single chamber / IP66/IP68 (1 bar)
		D	Aluminium double chamber / IP66/IP68 (0.2 bar)
		S	Special colour Aluminium double chamber / IP66/IP68 (0.2 bar)
		Y	Aluminium double chamber / IP66/IP67 with M12 x 1 for VEGADIS 61/81
		V	Stainless steel single chamber (precision casting) / IP66/IP68 (0.2 bar)
		5	Stainless steel single chamber (precision casting) / IP66/IP68 (1 bar)
		8	Stainless steel single chamber (electropolished) / IP66/IP68 (0.2 bar)
		W	Stainless steel double chamber / IP66/IP68 (0.2 bar)
		Q	Stainless steel double chamber / IP66/IP67 with M12 x 1 for VEGADIS 61/81
		R	Plastic double chamber / IP66/IP67
		X	Plastic double chamber / IP66/IP67 with M12 x 1 for VEGADIS 61/81
h	Cable entry / Cable gland, Plug connection	M	M20 x 1.5 / without
		N	½ NPT / without
		*	One-digit alphanumeric code for further suitable fittings, cable entries and closing screws.
i	Display and adjustment module PLICSCOM	X	without
		A	mounted
		F	without; lid with inspection window
		B	Laterally mounted
		K	mounted; with Bluetooth, magnetic pen operation
		L	laterally mounted; with Bluetooth, magnetic pen operation
		U	mounted; with Bluetooth, magnetic pen operation, battery
		S	laterally mounted; with Bluetooth, magnetic pen operation, battery
j	Additional equipment	X	without
		*	with equipment

## VEGAPULS PS66(\*).abcdefghijk

Position		Feature	Description
ab	Approval	CX	II 1G, 1/2G, 2G Ex ia IIC T6 ... T1 Ga, Ga/Gb, Gb
		CA	II 1G, 1/2G, 2G Ex ia IIC T6 ... T1 Ga, Ga/Gb, Gb + WHG
		CM	II 1G, 1/2G, 2G Ex ia IIC T6 ... T1 Ga, Ga/Gb, Gb + Ship approval
c	Version / Material	*	Horn antennas, standpipe; One-digit alphanumeric variable for metal antenna, standpipe with different metal materials and diameters

Position		Feature	Description
de	Process fitting / Material	**	Flanges, Clamp; two-digit alphanumeric code for metallic process fittings, industrial flanges according to ASME, BS, DIN, EN, GOST, HG/T, JIS and for other international, national or industrial standards, guidelines or standards with suitable pressure and temperature specifications
f	Seal / Process temperature	1	FKM (A+P GLT FPM 70.16-06) / -40 ... +80 °C
		2	FKM (A+P GLT FPM 70.16-06) / -40 ... +150 °C
		3	FFKM (Kalrez 6375) / -25 ... +150 °C
		4	Silicone FEP coated (A+P FEP-O-SEAL)-Viton / -40 ... +150 °C
		5	EPDM (A+P 70.10-02) / -40 ... +150 °C
		6	PTFE (Teflon) / -40 ... +200 °C
		G	Graphite and ceramic / -60 ... +250 °C
		I	Graphite and ceramic / -60 ... +300 °C
		H	Graphite and ceramic / -60 ... +400 °C
g	Electronics	P	Two-wire Profibus PA
		F	Two-wire Foundation Fieldbus
h	Housing / Protection	K	Plastic single chamber / IP66/IP67
		A	Aluminium single chamber / IP66/IP68 (0.2 bar)
		H	Special colour Aluminium single chamber / IP66/IP68 (0.2 bar)
		3	Aluminium single chamber / IP66/IP68 (1 bar)
		D	Aluminium double chamber / IP66/IP68 (0.2 bar)
		S	Special colour Aluminium double chamber / IP66/IP68 (0.2 bar)
		Y	Aluminium double chamber / IP66/IP67 with M12 x 1 for VEGADIS 61/81
		V	Stainless steel single chamber (precision casting) / IP66/IP68 (0.2 bar)
		5	Stainless steel single chamber (precision casting) / IP66/IP68 (1 bar)
		8	Stainless steel single chamber (electropolished) / IP66/IP68 (0.2 bar)
		W	Stainless steel double chamber / IP66/IP68 (0.2 bar)
		Q	Stainless steel double chamber / IP66/IP67 with M12 x 1 for VEGADIS 61/81
		R	Plastic double chamber / IP66/IP67
		X	Plastic double chamber / IP66/IP67 with M12 x 1 for VEGADIS 61/81
i	Cable entry / Cable gland, Plug connection	M	M20 x 1.5 / without
		N	½ NPT / without
		*	One-digit alphanumerical code for further suitable fittings, cable entries and closing screws.

Position		Feature	Description
j	Display and adjustment module PLICSCOM	X	without
		A	mounted
		F	without; lid with inspection window
		B	Laterally mounted
		K	mounted; with Bluetooth, magnetic pen operation
		L	laterally mounted; with Bluetooth, magnetic pen operation
		U	mounted; with Bluetooth, magnetic pen operation, battery
		S	laterally mounted; with Bluetooth, magnetic pen operation, battery
k	Additional equipment	X	without
		V	Purging connection with reflux valve
		*	with equipment

## VEGAPULS PS68(\*)/PSSR68(\*)abcdefghijkl

Position		Feature	Description
ab	Approval	CX	II 1G, 1/2G, 2G Ex ia IIC T6 ... T1 Ga, Ga/Gb, Gb
		CM	II 1G, 1/2G, 2G Ex ia IIC T6 ... T1 Ga, Ga/Gb, Gb + Ship approval
c	Version / Material	*	Horn antennas, standpipe, parabolic antenna; One-digit alphanumeric variable for metal antenna, standpipe with different metal materials and diameters
de	Process fitting / Material	**	Threaded connection, flanges, swivelling holder; two-digit alphanumeric code for metallic process fittings, industrial flanges according to ASME, BS, DIN, EN, GOST, HG/T, JIS and for other international, national or industrial standards, guidelines or standards with suitable pressure and temperature specifications
f	Seal / Process temperature	2	FKM (SHS FPM 70C3 GLT) and PTFE / -40 ... +130 °C
		Z	FKM (SHS FPM 70C3 GLT) and PTFE / -40 ... +100 °C
		3	FFKM (Kalrez 6375) and PTFE / -20 ... +130 °C
		4	FKM (SHS FPM 70C3 GLT) and PTFE / -40 ... +200 °C
		5	FFKM (Kalrez 6375) and PTFE / -20 ... +200 °C
		7	FFKM (Kalrez 6230) and PTFE (FDA) / -15 ... +130 °C
		9	FFKM (Kalrez 6230) and PTFE / -15 ... +200 °C
		A	FKM (SHS FPM 70C3 GLT) and PEEK / -40 ... +200 °C
		E	FFKM (Kalrez 6230) and PEEK / -15 ... +250 °C
		F	FFKM (Kalrez 6375) and PEEK / -20 ... +250 °C
g	Electronics	H	Ceramic graphite / -196 ... +450 °C
		P	Two-wire Profibus PA
		F	Two-wire Foundation Fieldbus

Position		Feature	Description
h	Housing / Protection	K	Plastic single chamber / IP66/IP67
		A	Aluminium single chamber / IP66/IP68 (0.2 bar)
		H	Special colour Aluminium single chamber / IP66/IP68 (0.2 bar)
		3	Aluminium single chamber / IP66/IP68 (1 bar)
		D	Aluminium double chamber / IP66/IP68 (0.2 bar)
		S	Special colour Aluminium double chamber / IP66/IP68 (0.2 bar)
		Y	Aluminium double chamber / IP66/IP67 with M12 x 1 for VEGADIS 61/81
		V	Stainless steel single chamber (precision casting) / IP66/IP68 (0.2 bar)
		5	Stainless steel single chamber (precision casting) / IP66/IP68 (1 bar)
		8	Stainless steel single chamber (electropolished) / IP66/IP68 (0.2 bar)
		W	Stainless steel double chamber / IP66/IP68 (0.2 bar)
		Q	Stainless steel double chamber / IP66/IP67 with M12 x 1 for VEGADIS 61/81
		R	Plastic double chamber / IP66/IP67
		X	Plastic double chamber / IP66/IP67 with M12 x 1 for VEGADIS 61/81
i	Cable entry / Cable gland, Plug connection	M	M20 x 1.5 / without
		N	½ NPT / without
		*	One-digit alphanumeric code for further suitable fittings, cable entries and closing screws.
j	Display and adjustment module PLICSCOM	X	without
		A	mounted
		F	without; lid with inspection window
		B	Laterally mounted
		K	mounted; with Bluetooth, magnetic pen operation
		L	laterally mounted; with Bluetooth, magnetic pen operation
		U	mounted; with Bluetooth, magnetic pen operation, battery
		S	laterally mounted; with Bluetooth, magnetic pen operation, battery
k	Additional equipment	X	without
		*	with equipment

In the following, all above mentioned versions are called VEGAPULS 61, 62, 63, 65, 66, 68, SR68. If parts of these safety instructions refer only to certain versions, then these will be mentioned explicitly with their type code.

## 4 Technical data

### Electrical data

#### Type of protection intrinsic safety Ex i

Power supply and signal circuit: (terminals 1[+], 2[-] in electronics compartment or for the double chamber housing version in termination compartment)

In type of protection intrinsic safety Ex ia IIC

For connection to a certified, intrinsically safe circuit.

Maximum values:

- $U_i = 17.5 \text{ V}$
- $I_i = 500 \text{ mA}$
- $P_i = 5.5 \text{ W}$

$C_i$  negligibly small.

$L_i \leq 10 \mu\text{H}$ .

The instrument is suitable for connection to a Fieldbus system according to the FISCO model, e.g. Profibus PA or Foundation Fieldbus.

or

- $U_i = 24 \text{ V}$
- $I_i = 250 \text{ mA}$
- $P_i = 1.2 \text{ W}$

$C_i$  negligibly small.

$L_i \leq 10 \mu\text{H}$ .

In the version with fix mounted connection cable,  $L_i = L'_{i \text{ cable}} (0,55 \mu\text{H/m}) + 10 \mu\text{H}$ ,  $C_i = C'_{i \text{ wire/wire}} (159 \text{ pF/m}) + C'_{i \text{ wire/screen}} (270 \text{ pF/m})$  must be taken into account.

Indicating and adjustment circuit: (terminals 5, 6, 7, 8 in electronics compartment or plug connection; with double chamber housing version in the connection compartment)

In type of protection intrinsic safety Ex ia IIC

For connection to the intrinsically safe circuit of the corresponding external display unit VEGADIS 61/81.

The rules for the interconnection of intrinsically safe circuits between VEGAPULS 61, 62, 63, 65, 66, 68, SR68 and the external indicating unit VEGADIS 61/81 are fulfilled, provided that the total inductance and total capacitance of the connection cable between VEGAPULS 61, 62, 63, 65, 66, 68, SR68 and the external indicating unit VEGADIS 61/81  $L_{\text{cable}} = 310 \mu\text{H}$  and  $C_{\text{cable}} = 2 \mu\text{F}$  are not exceeded.

When using the delivered VEGA connection cable between VEGAPULS 61, 62, 63, 65, 66, 68, SR68 and the external indicating unit VEGADIS 61/81, the following listed cable inductances  $L_i$  and cable capacitances  $C_i$  must be taken into account with a cable length  $\geq 50 \text{ m}$ .

- $L'_i = 0.62 \mu\text{H/m}$
- $C'_{i \text{ wire/wire}} = 132 \text{ pF/m}$
- $C'_{i \text{ wire/screen}} = 208 \text{ pF/m}$
- $C'_{i \text{ screen/screen}} = 192 \text{ pF/m}$

Circuit of the display and adjustment module: (spring contacts in the electronics compartment; with double chamber housing version also in the connection compartment)

In type of protection intrinsic safety Ex ia IIC

Only for connection to the display and adjustment module PLICSCOM or VEGACONNECT.

With the double chamber housing version, the display and adjustment module may be mounted either in the electronics compartment or in the termination compartment.

For applications requiring instruments of category 2G, the intrinsically safe power supply and signal circuit can correspond to protection class ia or ib. For connection to a circuit with protection class ib, the ignition protection type identification is Ex ib IIC T6.

For applications requiring instruments of category 1G or 1/2G, the intrinsically safe power supply and signal circuit must correspond to protection class ia.

For applications requiring instruments of category 1G or 1/2G the VEGAPULS 61, 62, 63, 65, 66, 68, SR68 is preferably connected to appropriate equipment with galvanically isolated, intrinsically safe circuits.

The metal parts of the level measuring instruments on radar basis type VEGAPULS PS6\* are electrically connected to the earth terminals.

In the versions of the radar sensors VEGAPULS 61, 62, 63, 65, 66, 68, SR68 the intrinsically safe circuits are electrically isolated from elements that may be earthed.

## 5 Application conditions

### VEGAPULS 61, 62, 63, 65, 66, 68, SR68

The max. permissible ambient temperatures depending on the temperature classes are specified in the following tables.

For assessment and reduction of the explosion risk, valid standards such as for example EN 1127-1 must be taken into account.

#### Category 1G instruments

Temperature class	Temperature on the antenna	Ambient temperature on the electronics
T5	-20 ... +42 °C	-20 ... +42 °C
T4, T3, T2, T1	-20 ... +60 °C	-20 ... +60 °C

For applications requiring instruments of category 1G the process pressure of the media must be between 0.8 ... 1.1 bar. The application conditions when operating in the absence of explosive mixtures can be found in the manufacturer information.

#### Category 1/2G instruments

Temperature class	Temperature on the antenna	Ambient temperature on the electronics
T6	-20 ... +60 °C	-40 ... +46 °C
T5	-20 ... +60 °C	-40 ... +61 °C
T4, T3, T2, T1	-20 ... +60 °C	-40 ... +80 °C

For applications requiring instruments of category 1G the process pressure of the media must be between 0.8 ... 1.1 bar. If the VEGAPULS 61, 62, 63, 65, 66, 68, SR68 are operated at temperatures

higher than those specified in the above table, please make sure by means of appropriate measures that there is no danger of ignition from the hot surfaces. The max. permissible temperature on the electronics/housing should not exceed the values according to the above table.

Please make sure that the sensor also in case of failure does not generate heat itself. Responsibility for safe operation of the equipment, with respect to pressures/temperatures of the materials used, rests with the operator.

The prerequisites for operation in the absence of explosive mixtures can be found in the manufacturer specifications.

## VEGAPULS 61

### Category 2G instruments

Temperature class	Temperature on the antenna	Ambient temperature on the electronics
T6	-60 ... +80 °C	-40 ... +46 °C
T5	-60 ... +80 °C	-40 ... +61 °C
T4, T3, T2, T1	-60 ... +80 °C	-40 ... +80 °C

## VEGAPULS 62

### Category 2G instruments

Temperature class	Temperature on the antenna	Ambient temperature on the electronics
T6	-60 ... +80 °C	-40 ... +46 °C
T5	-60 ... +95 °C	-40 ... +61 °C
T4	-60 ... +130 °C	-40 ... +80 °C
T3	-60 ... +195 °C	-40 ... +80 °C
T2	-60 ... +290 °C	-40 ... +80 °C
T1	-60 ... +440 °C	-40 ... +80 °C

### Category 2G instrument - low temperature version up to -170 °C

Temperature class	Temperature on the antenna	Ambient temperature on the electronics
T6	-170 ... +80 °C	-40 ... +46 °C
T5	-170 ... +95 °C	-40 ... +61 °C
T4	-170 ... +130 °C	-40 ... +80 °C
T3	-170 ... +195 °C	-40 ... +80 °C
T2	-170 ... +290 °C	-40 ... +80 °C
T1	-170 ... +440 °C	-40 ... +80 °C

## VEGAPULS 63

### Category 2G instruments

Temperature class	Temperature on the antenna	Ambient temperature on the electronics
T6	-60 ... +80 °C	-40 ... +46 °C
T5	-60 ... +95 °C	-40 ... +61 °C
T4	-60 ... +130 °C	-40 ... +80 °C
T3, T2, T1	-60 ... +195 °C	-40 ... +80 °C

### Category 2G instrument - low temperature version up to -170 °C

Temperature class	Temperature on the antenna	Ambient temperature on the electronics
T6	-170 ... +80 °C	-40 ... +46 °C
T5	-170 ... +95 °C	-40 ... +61 °C
T4	-170 ... +130 °C	-40 ... +80 °C
T3, T2, T1	-170 ... +195 °C	-40 ... +80 °C

## VEGAPULS 65

### Category 2G instruments

Temperature class	Temperature on the antenna	Ambient temperature on the electronics
T6	-60 ... +80 °C	-40 ... +46 °C
T5	-60 ... +95 °C	-40 ... +61 °C
T4	-60 ... +130 °C	-40 ... +80 °C
T3, T2, T1	-60 ... +150 °C	-40 ... +80 °C

## VEGAPULS 66

### Category 2G instruments

Temperature class	Temperature on the antenna	Ambient temperature on the electronics
T6	-60 ... +80 °C	-40 ... +46 °C
T5	-60 ... +95 °C	-40 ... +61 °C
T4	-60 ... +130 °C	-40 ... +80 °C
T3	-60 ... +195 °C	-40 ... +80 °C
T2	-60 ... +290 °C	-40 ... +80 °C
T1	-60 ... +400 °C	-40 ... +80 °C



## VEGAPULS 68, SR68

### Category 2G instruments

Temperature class	Temperature on the antenna		Ambient temperature on the electronics
	VEGAPULS PS68	VEGAPULS PSSR68	
T6	-60 ... +80 °C		-40 ... +46 °C
T5	-60 ... +95 °C		-40 ... +61 °C
T4	-60 ... +130 °C		-40 ... +80 °C
T3	-60 ... +195 °C		-40 ... +80 °C
T2	-60 ... +290 °C	-60 ... +250 °C	-40 ... +80 °C
T1	-60 ... +440 °C	-60 ... +250 °C	-40 ... +80 °C

If the VEGAPULS 61, 62, 63, 65, 66, 68, SR68 are operated at higher temperatures than those specified in the above table, please make sure by means of appropriate measures that there is no danger of ignition from hot surfaces. The max. permissible temperature on the electronics/housing must not exceed the values specified in the above table.

Please make sure that the sensor also in case of failure does not generate heat itself. Responsibility for safe operation of the equipment, with respect to pressures/temperatures of the materials used, rests with the operator.

The prerequisites for operation in the absence of explosive mixtures can be found in the manufacturer specifications.

## 6 Protection against static electricity

The VEGAPULS 61, 62, 63, 65, 66, 68, SR68 in versions with electrostatically chargeable plastic parts, such as e.g. plastic housing, metal housing with inspection window or plastic antenna, have a caution label pointing out the safety measures that must be taken with regard to electrostatic charges during operation.

**WARNING - POTENTIAL ELECTROSTATIC CHARGING HAZARD - SEE INSTRUCTIONS**

Caution: Plastic parts! Danger of electrostatic charging!

- Avoid friction
- No dry cleaning
- Construction/Installation: The VEGAPULS 61, 62, 63, 65, 66, 68, SR68 must be constructed/ installed in such a way that
  - electrostatic charges are ruled out during operation, maintenance and cleaning.
  - process-related electrostatic charges, e.g. by measuring media flowing past, are ruled out

## 7 Use of an overvoltage arrester

If necessary, a suitable overvoltage arrester can be connected in front of the VEGAPULS 61, 62, 63, 65, 66, 68, SR68.

When used as category 1G or 1/2G instrument, a suitable overvoltage arrester must be connected in between as protection against overvoltages, as far as required according to EN 60079-14.

## 8 Grounding

In order to avoid the danger of electrostatic charging of the metallic parts, the VEGAPULS 61, 62, 63, 65, 66, 68, SR68 must be electrostatically connected to the local potential equalisation (transfer resistance  $\leq 1 \text{ M}\Omega$ ), e.g. via the ground terminal, when used as category 1G or 1/2G instruments.

## 9 Impact and friction sparks

When used as category 1G instruments, the VEGAPULS 61, 62, 63, 65, 66, 68, SR68 in aluminium/titanium versions must be mounted in such a way that sparks from impact and friction between aluminium/titanium and steel (except stainless steel, if the presence of rust particles can be excluded) cannot occur.

## 10 Material resistance

For applications requiring instruments of category 1G or category 1/2G the VEGAPULS 61, 62, 63, 65, 66, 68, SR68 must only be used in products against which the wetted materials are sufficiently resistant.

## 11 Mounting with external display unit VEGADIS 61/81


The intrinsically safe signal circuit between VEGAPULS 61, 62, 63, 65, 66, 68, SR68 and the external indicating unit VEGADIS 61/81 should be set up without grounding. The required insulation voltage is  $> 500 \text{ V AC}$ . When using the VEGA connection cable included with the delivery, this requirement is fulfilled. If grounding of the cable screen is required, it must be carried out according to EN 60079-14.

## 12 Removing and replacing the red threaded/dust cover

When the VEGAPULS 61, 62, 63, 65, 66, 68, SR68 are delivered, depending on the version, the red threaded or dust protection caps must be removed before installing the device and the openings must be sealed according to the requirements of the type of protection and the IP protection type specified on the type label.

When using certified i.e. suitable cable glands, sealing plugs or plug connectors, they must be mounted correctly and the respective certificates/documents must be observed.

The sealing plugs included in the delivery by VEGA meet the necessary requirements.

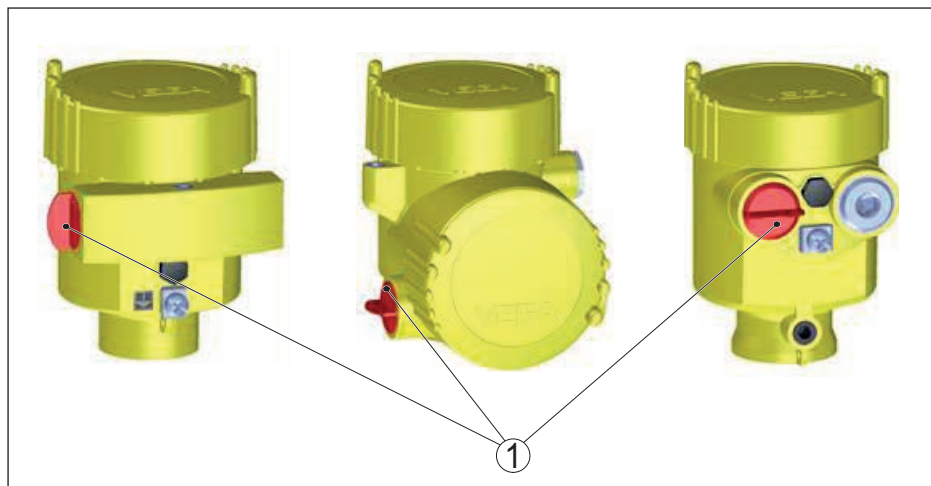

1 Red threaded or dust protection cap

## 13 Versions with antenna extension

The VEGAPULS 61, 62, 63, 65, 66, 68, SR68 with antenna extension have to be mounted so that the extension is effectively secured against bending or oscillating as well as contact of the sensor to the vessel wall, under consideration of the vessel installations and flow conditions in the vessel.

## 14 Installation with swivelling holder

VEGAPULS 61, 62, 63, 65, 66, 68, SR68 as category 1/2G instrument in the version with swivelling holder must be installed in such a way that, after the antenna has been aligned (by means of the swivelling holder) and the mounting flange screwed on, protection rating IP67 is maintained.

## 15 Versions with rinsing connection

For VEGAPULS 61, 62, 63, 65, 66, 68, SR68 as category 1/2G instrument in the version with rinsing connection make sure the protection rating IP67 is ensured on the connection to the reflux valve.

After removal of the reflux valve or the rinsing air connection on the reflux valve, the opening has to be closed with an appropriate closing screw, so that protection class IP67 is maintained. Please make sure that during rinsing processes in the antennas, i.e. when the sensor is cleaned, no hazardous atmosphere is present.

## Confirmation

Hereby the company VEGA Grieshaber KG declares that the approved CCOE devices have been manufactured in accordance with the ATEX approval mentioned in the attached CCOE certificate.

---

**VEGA Grieshaber KG**  
A m H o h e n s t e i n 1 1 3  
77761 Schiltach/Germany  
T e l . + 4 9 7 8 3 6 5 0 - 0  
E-mail: info@vega.com - www.vega.com







Printing date:

# VEGA

All statements concerning scope of delivery, application, practical use and operating conditions of the sensors and processing systems correspond to the information available at the time of printing.

Subject to change without prior notice

© VEGA Grieshaber KG, Schiltach/Germany 2023

62515-EN-230309

VEGA Grieshaber KG  
Am Hohenstein 113  
77761 Schiltach  
Germany

Phone +49 7836 50-0  
E-mail: [info.de@vega.com](mailto:info.de@vega.com)  
[www.vega.com](http://www.vega.com)