



## Safety instructions

### VEGADIF 85

Flameproof enclosures

Two-wire 4 ... 20 mA

Two-wire 4 ... 20 mA/HART

Two-wire 4 ... 20 mA/HART with SIL qualification

Profibus PA

Foundation Fieldbus

Modbus



Document ID: 1013798



# VEGA

## Contents

<b>1</b>	<b>Scope .....</b>	<b>3</b>
<b>2</b>	<b>Type code specifications .....</b>	<b>3</b>
<b>3</b>	<b>General information .....</b>	<b>4</b>
<b>4</b>	<b>Application area .....</b>	<b>4</b>
	4.1 Division and Classes .....	4
	4.2 Zones .....	4
<b>5</b>	<b>Specific conditions of use ("X" identification) .....</b>	<b>5</b>
<b>6</b>	<b>Important information for mounting and maintenance.....</b>	<b>5</b>
<b>7</b>	<b>Safe operating mode .....</b>	<b>8</b>
<b>8</b>	<b>Instructions for zone 0, zone 0/1 applications .....</b>	<b>9</b>
<b>9</b>	<b>Potential equalization/Grounding .....</b>	<b>9</b>
<b>10</b>	<b>Electrostatic charging (ESD) .....</b>	<b>9</b>
<b>11</b>	<b>Electrical data.....</b>	<b>10</b>
<b>12</b>	<b>Thermal data .....</b>	<b>11</b>

Supplementary documentation:

- Operating Instructions VEGADIF 85
- Certificate of Conformity FM22US0052X (Document ID: 1013795)

Editing status: 2022-11-30

## 1 Scope

These safety instructions apply to the differential pressure transmitters VEGADIF 85 in the versions described in chapter " *Type code specifications*".

The classification as well as the respective standards are stated in the Certificate of Conformity FM22US0052X.

- XP-IS / CL I, DIV 1, Gp ABCD T6...T1
- CL I, Zn 0/1, AEx ia/db IIC T6...T1 Ga/Gb
- CL I, Zn 1, AEx db ia IIC T6...T1 Gb

## 2 Type code specifications

In the following, all above mentioned versions are called VEGADIF 85. If parts of these safety instructions refer only to certain versions, then these will be mentioned explicitly with their type code.

### VEGADIF DF85(\*).ab\*\*\*\*\*hijklm\*

Position		Feature	Description
a	Scope	F	FM-us
b	Approval	E	FM (XP) CL I, DIV 1, Gp ABCD; Zn 1, AEx db ia IIC, Gb
		Q	FM (XP) CL I, DIV 1, Gp ABCD; Zn 1, AEx db ia IIC, Gb + Ship approval
h	Electronics	Z	Two-wire 4 ... 20 mA
		H	Two-wire 4 ... 20 mA/HART
		U	Four-wire Modbus
		A	Two-wire 4 ... 20 mA/HART with SIL qualification
		P	Two-wire Profibus PA
		F	Two-wire Foundation Fieldbus
i	Supplementary electronics	X	without
		Z	Additional current output 4 ... 20 mA
j	Housing	A	Aluminium - single chamber
		V	Stainless steel single chamber (precision casting)
k	Housing version / Protection	D	compact / IP66/IP68 (0,2 bar); NEMA 6P
		A	axial cable outlet IP68 (PUR) with external housing / IP66/IP67; NEMA 4X
		S	lateral cable outlet IP68 (PUR) with external housing / IP66/IP67; NEMA 4X
		K	axial cable outlet IP68 (PE) with external housing / IP66/IP67; NEMA 4X
		L	lateral cable outlet IP68 (PE) with external housing / IP66/IP67; NEMA 4X

Position		Feature	Description
l	Cable entry	D	M20 x 1.5 / Blind plug
		1	M20 x 1.5 / without
		N	½ NPT / Blind plug
		Q	½ NPT / without
		O	M20 x 1.5 / cable gland brass nickel-plated
		6	M20 x 1.5 / Cable gland brass nickel-plated, for shielded cable
m	Display and adjustment module PLICSCOM	X	without
		A	mounted
		K	mounted; with Bluetooth, magnetic pen operation
		F	without; lid with inspection window
		B	Laterally mounted
		L	laterally mounted; with Bluetooth, magnetic pen operation

### 3 General information



VEGADIF 85 is a differential pressure transmitter for measurement of differential pressure, flow, level, density and interface.

It consists of a differential pressure measuring cell and an electronics housing which is optionally also executed as external housing.

The display and adjustment module PLICSCOM can be mounted optionally.

### 4 Application area

#### 4.1 Division and Classes

Division Designation	Class/Group Designation
	CL I (GP A, B, C, D)
DIV 2	
DIV 1	

#### 4.2 Zones





##### EPL Gb instrument

The measured medium inside the sensor requires an EPL Gb instrument and the differential pressure measurement component or the electronics housing with separate version is in an area in which EPL Gb instruments are required.



**Note:**

A direct installation in the vessel wall is not planned for this instrument!

Zone	Device protection level	
	EPL Gc	EPL Gb
Ex Zone 2 		
Ex Zone 1 		

## 5 Specific conditions of use ("X" identification)

The following overview is listing all special properties of VEGADIF 85, which make a labelling with the symbol "X" behind the certificate number necessary.

1. For information only: The permissible ambient resp. medium temperature range depends on the variant of the apparatus and on the temperature class, for which the apparatus shall be used (see thermal data). The limits of the permissible ambient temperature range may be restricted by the used O-ring material. The used O-ring material is included in the marking. The permissible temperature ranges in dependence of the material have to be taken from the manufacturer's instructions.

2. For use as Ga/Gb-apparatus:

For functional reasons, the partition wall (membrane) to the wetted area has a wall thickness < 1 mm. In the application, it has to be ensured, that an impairment of the separation wall e. g. by aggressive media or mechanical hazards is excluded.

For variants with standard process connections:

The installation of the meter bodies shall provide as a minimum degree of protection IP67 according to ANSI/IEC 60529 for the process connections and vents.

For variants with capillary connections:

The capillary connections are designed to be connected to a capillary with diaphragm seal. The filling holes are intended to bring in a fill fluid. To prevent a zone entrainment from Zone 0, the diaphragm seal resp. the diaphragm seal and capillary have to be suitably designed. The pressure transfer system has to be technically tight. The filling hole has to be tightly sealed.

3. At the plastic parts there is a danger of ignition by electrostatic discharge. Observe manual of the manufacturer and warning label.

4. At the metallic parts made of light metal there is a danger of ignition by impact or friction. Observe manual of the manufacturer.

5. For the execution with separate housing, potential equalization has to exist in the complete course of the erection of the connecting cable between the electronics housing and the measuring sensor housing.

6. For use as Flameproof equipment, it is not allowed to repair the flamepath joints.

## 6 Important information for mounting and maintenance

### General instructions


The following requirements must be fulfilled for mounting, electrical installation, setup and maintenance of the instrument:

- The staff must be qualified according the respective tasks
- The staff must be trained in explosion protection
- The staff must be familiar with the relevant valid regulations which are necessary for the safe installation and operation of the device.
- Make sure when working on the instrument (mounting, installation, maintenance) that there is no explosive atmosphere present, the supply circuits should be voltage-free, if possible.
- The instrument has to be mounted according to the manufacturer specifications, the Certificate of Conformity, National Electrical Code and the valid regulations and standards
- Modifications on the instrument can influence the explosion protection and hence the safety, therefore repairs are not permitted to be conducted by the end user
- Modifications must only be carried out by employees authorized by VEGA company
- Use only approved spare parts
- Components for installation and connection not included in the approval documents are only permitted if these correspond technically to the latest standard mentioned on the cover sheet. They must be suitable for the application conditions and have a separate certificate. The special conditions of the components must be noted and if necessary, the components must be integrated in the type test. This applies also to the components already mentioned in the technical description.

### **Cable and wire entries**

- The VEGADIF 85 must be connected via suitable cable gland or conduit systems that are in conformity with the requirements of the type of protection and the IP protection and provided with a separate type approval certificate. When connecting VEGADIF 85 to conduit systems, the corresponding sealing facility must be connected directly to the housing.
- The red thread or/dust covers screwed in when the instruments are shipped (depending on the version) must be removed before setup and replaced by cable entries or closing screws suitable for the respective ignition protection type and IP protection.
- Note type and size of the thread: A label with the respective thread name is in the area of the respective thread
- Threads must have no damages
- Cable entries and closing screws should be mounted correctly and according to the safety instructions of the manufacturer to ensure the specified ignition protection type and IP protection rating. When using certified or suitable cable glands, closing screws or plug connections, it is absolutely necessary to note the corresponding certificates/documents. Supplied cable entries or closing screws meet these requirements.
- Unused openings must be closed with plugs suitable for the ignition protection type and IP protection. Supplied plugs meet these requirements.
- Cable or wire entries resp. the closing screws must be tightly screwed into the housing
- The connection cables resp. pipeline sealing facilities must be suitable for the application conditions (e.g. temperature range) of the application
- With surface temperatures > 70 °C, the cables must be suitable for the higher application conditions
- The connection cable of VEGADIF 85 has to be wired fix and in such a way that damages can be excluded.

## Single chamber housing

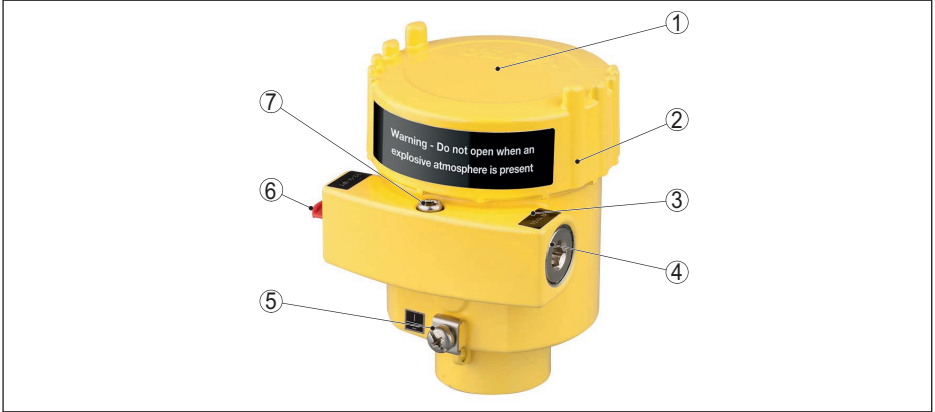

- 1 Lid, optionally with inspection window
- 2 Electronics compartment
- 3 Label: Thread type
- 4 Screw plug
- 5 External ground terminal
- 6 Red threaded or dust protection cap  
Transport protection, replace with installation
- 7 Locking screws of the lid for lid locking

## Double chamber housing



- 1 Lid, optionally with inspection window
- 2 Electronics compartment
- 3 Screw plug
- 4 Connection compartment
- 5 Transport protection, replace with installation  
Red threaded or dust protection cap
- 6 Label: Thread type
- 7 Locking screws of the lid for lid locking
- 8 Lid, optionally with inspection window
- 9 Locking screws of the lid for lid locking

## Mounting

Keep in mind for instrument mounting

- Mechanical damage on the instrument must be avoided
- Mechanical friction must be avoided
- Vessel installations and probable flow must be taken into account
- Process connections separating two areas of different Ex-zones must comply to valid regulations and standards and the protection rating must be in conformity to IEC/EN 60529
- Close the housing lid (s) up to the stop before starting operating, to ensure the IP protection rating specified on the type label
- Protect the lid against unauthorized opening by unscrewing the locking screw up to the stop. With double chamber housing, you have to protect both lids.

## Maintenance

To ensure the functionality of the device, periodic visual inspection is recommended for:

- Secure mounting
- No mechanical damages or corrosion
- Worn or otherwise damaged cables
- No loose connections of the line connections, equipotential bonding connections
- Correct and clearly marked cable connections

The parts of the VEGADIF 85 being in contact with flammable media during operation must be included in the periodic overpressure test of the plant.

## Flameproof enclosure "d"

- The terminals for connecting the operating voltage or signal circuits are integrated in the connection compartment with type of protection flameproof enclosure "d"
- The thread gaps between housing and cover as well as between threaded fitting and container are flameproof joints
- It is not allowed to repair the flameproof joints.
- Cable, wire entries and closing screws must be certified acc. to ignition protection type "Flameproof enclosures Ex d". Cable, wire entries and closing screws of simple design must not be used.
- Separately certified cable and wire entries can determine the permissible ambient temperature range or the temperature classes
- For connection to a "Conduit" system the corresponding sealing facility must be attached directly to the "Ex d" connection compartment
- Unused openings must be sealed according to ignition protection type "Flameproof enclosures Ex d"
- Only one threaded adapter is allowed per thread, when using a closing screw, threaded adapters are not allowed

## 7 Safe operating mode

### General operating conditions

- Do not operate the instrument outside the electrical, thermal and mechanical specifications of the manufacturer
- Use the instrument only in media against which the wetted parts are sufficiently resistant
- Note the relation between process temperature on the sensor/antenna and the permissible ambient temperature on the electronics housing. For permissible temperatures, see the respective temperature tables. See chapter " *Thermal data*".
- If necessary, a suitable overvoltage arrester can be connected in front of the VEGADIF 85



- Lids must not be opened if there is a hazardous atmosphere. The housing lids are marked with the warning label:

WARNING - DO NOT OPEN WHEN AN  
EXPLOSIVE ATMOSPHERE IS PRESENT

- Components for installation and connection not included in the approval documents are only permitted if these correspond technically to the latest standard mentioned on the cover sheet. They must be suitable for the application conditions and have a separate certificate. The special conditions of the components must be noted and if necessary, the components must be integrated in the type test. This applies also to the components already mentioned in the technical description.

## 8 Instructions for zone 0, zone 0/1 applications

In hazardous areas, the instrument, sensor measuring system in zone 0 should only be operated under atmospheric conditions:

- Temperature: -20 ... +60 °C.
- Pressure: 80 ... 110 kPa (0.8 ... 1.1 bar)
- Air with normal oxygen content, normally 21 %

The operator must ensure that the medium temperature in zone 0 is not higher than 80 % of the self-ignition temperature of the concerned medium (in °C) and does not exceed the max. permissible flange temperature depending on the temperature class. The parts of the sensor which during operation are in contact with flammable products, must be integrated in the periodic overpressure test of the plant.

If no explosive mixtures or additional application conditions are certified resp. supplementary measures such as e.g. according to ISO/EN 1127-1 taken, then the instruments can be also operated according to the manufacturer specification outside atmospheric conditions.

If there is a risk of dangerous potential differences inside zone 0, then suitable measures for circuits in zone 0 must be taken, e.g. according to the requirements of IEC/EN 60079-14.

Process fittings between two explosion protection areas require category 1G (EPL Ga) and less endangered areas must show a tightness in accordance with protection rating IP67 acc. to IEC/EN 60529.

## 9 Potential equalization/Grounding

- Integrate the instruments into the local potential equalisation, e.g. via the internal or external earth terminal
- The potential equalization terminal must be secured against loosening
- If grounding of the cable screening is necessary, this must be carried out acc. to the valid standards and regulations, e.g. acc. to IEC/EN 60079-14
- For the version with separate housing, the potential equalization must be provided in the complete range of the connection cable between electronics housing and transmitter housing

## 10 Electrostatic charging (ESD)

In case of instrument versions with electrostatically chargeable plastic parts, the danger of electrostatic charging and discharging must be taken into account!

The following parts can charge and discharge:

- Lacquered housing version or alternative special lacquering

- Plastic housing, plastic housing parts
- Metal housing with inspection window
- Plastic process fittings
- Plastic-coated process fittings and/or plastic-coated sensors
- Connection cable for separate versions
- Type label
- Isolated metallic labels (measuring point identification plate)

Take note in case of danger of electrostatic charges:

- Avoid friction on the surfaces
- Do not dry clean the surfaces

The instruments must be mounted/installed in such a way that the following can be ruled out:

- electrostatic charges during operation, maintenance and cleaning.
- process-related electrostatic charges, e.g. by measuring media flowing past

The warning label indicates danger:

WARNING - POTENTIAL ELECTROSTATIC  
CHARGING HAZARD - SEE INSTRUCTIONS

## 11 Electrical data

<b>Supply and signal circuit:</b>	
VEGADIF DF85(*).*****Z/H/AXA/V**** Terminal 1[+], 2[-] in electronics compartment of the single chamber housing	U = 9.6 ... 35 V DC U <sub>m</sub> = 253 V AC
VEGADIF DF85(*).*****Z/H/AXD/W**** Terminal 1[+], 2[-] in connection compartment of the double chamber housing	
<b>VEGADIF DF85.*****Z/H/AZD/W****</b>	
<b>Supply and signal circuit I:</b> Terminal 1[+], 2[-] in connection compartment of the double chamber housing	U = 9.6 ... 35 V DC U <sub>m</sub> = 253 V AC
<b>Supply and signal circuit II:</b> Terminal 17[+], 18[-] in connection compartment of the double chamber housing	
<b>VEGADIF DF85.*****UXD/W****</b>	
<b>Supply and signal circuit I:</b> Terminal 1[+], 2[-] in connection compartment of the double chamber housing	U = 8 ... 32 V DC U <sub>m</sub> = 253 V AC
<b>Supply and signal circuit II:</b> Terminal MB[+], MB[-] in connection compartment of the double chamber housing	U = 5 V DC U <sub>m</sub> = 253 V AC MODBUS telegram

<b>VEGADIF DF85.*****UXD/W****</b>	
<b>Supply and signal circuit III:</b> 6-pole mini-USB socket in the connection compartment of the double chamber housing	U = 5 V DC U <sub>m</sub> = 253 V AC USB protocol

<b>Supply and signal circuit:</b>	
VEGADIF DF85.*****P/FXA/V**** Terminal 1[+], 2[-] in electronics compartment of the single chamber housing	U = 9 ... 32 V DC U <sub>m</sub> = 253 V AC
VEGADIF DF85.*****P/FXD/W**** Terminal 1[+], 2[-] in connection compartment of the double chamber housing	

<b>Display and adjustment circuit:</b>	
VEGADIF DF85.*****Z/H/A/U/P/F*A/V**** Terminals 5, 6, 7, 8 in electronics compartment of the single chamber housing	Only for connection to the associated VEGA display unit VEGADIS 61/81 with corresponding approval e. g. FM 16 US 0057 X.
VEGADIF DF85.*****Z/H/A/P/F*D/W**** Terminals 5, 6, 7, 8 in connection compartment of the double chamber housing	
Spring contacts in electronics compartment of the double chamber housing	Only for connection to the display and adjustment module PLICSCOM.

<b>Measuring circuit:</b>	
VEGADIF DF85.*****A/S/K/L*** Terminals in external housing: 1[yellow], 2[white], 3[red], 4[black]	In the version with remote sensor component, a length of the supplied cable of max. 180 m is permitted.  The intrinsically safe circuits to the remote sensor component are galvanically connected to ground potential.

## 12 Thermal data

The following temperature tables apply to all housing and electronic versions and for the use as EPL Ga/Gb and EPL Gb instrument.

### VEGADIF 85(\*).\*\*\*\*\*D\*\*\* (Compact version)

Temperature class	Ambient temperature (Ta) or medium temperature (Tp) on the sensor housing and the sensor
T6 (+85 °C)	-40 ... +55 °C
T5 (+100 °C)	
T4 (+135 °C)	-40 ... +60 °C
T3 (+200 °C)	
T2 (+300 °C)	
T1 (+450 °C)	

**VEGADIF 85(\*)..\*\*\*\*\*U\*\*A/S/K/L\*A/K/F/B/L/S\* (version with external housing, with Modbus barrier and/or PLICSCOM)**

Temperature class	Ambient temperature (Ta) on the sensor housing	Ambient temperature (Ta) or medium temperature (Tp) on the sensor
T6 (+85 °C)	-40 ... +60 °C	-40 ... +55 °C
T5 (+100 °C)		-40 ... +85 °C
T4 (+135 °C)		
T3 (+200 °C)		
T2 (+300 °C)		
T1 (+450 °C)		

**VEGADIF 85(\*)..\*\*\*\*\*Z/H/A/P/F\*\*A/S/K/L\*X\* (version with external housing, without Modbus barrier and/or without PLICSCOM)**

Temperature class	Ambient temperature (Ta) on the sensor housing	Ambient temperature (Ta) or medium temperature (Tp) on the sensor
T6 (+85 °C)	-50 ... +60 °C	-40 ... +55 °C
T5 (+100 °C)		-40 ... +85 °C
T4 (+135 °C)		
T3 (+200 °C)		
T2 (+300 °C)		
T1 (+450 °C)		







Printing date:

**VEGA**

All statements concerning scope of delivery, application, practical use and operating conditions of the sensors and processing systems correspond to the information available at the time of printing.

Subject to change without prior notice

© VEGA Grieshaber KG, Schiltach/Germany 2023

1013798-EN-230919

VEGA Grieshaber KG  
Am Hohenstein 113  
77761 Schiltach  
Germany

Phone +49 7836 50-0  
E-mail: [info.de@vega.com](mailto:info.de@vega.com)  
[www.vega.com](http://www.vega.com)