



Safety instructions

VEGAPULS 61, 62, 63, 65, 66, 68, SR68

Intrinsic safety and flameproof enclosure

Two-wire 4 ... 20 mA/HART

Four-wire 4 ... 20 mA/HART

Profibus PA

Foundation Fieldbus

Modbus

HW ≥ 2.0.0 - SW ≥ 4.0.0



Document ID: 37780



VEGA

Contents

1	Area of applicability.....	3
2	Important specification in the type code.....	3
3	General information.....	4
4	Application area.....	5
5	Specific conditions of use	5
6	Additional instructions for safe operation	6
7	Important information for mounting and maintenance.....	7
8	Potential equalization/Grounding	7
9	Electrostatic charging (ESD).....	7
10	Type of protection flameproof enclosure Ex "db", "XP"	8
11	Versions with antenna extension	9
12	Versions with ball valve.....	9
13	Impact and friction sparks	9
14	Material resistance	9
15	Installation with swivelling holder.....	9
16	Versions with rinsing connection.....	10
17	Mounting with external display unit VEGADIS 61/81.....	10
18	Removing and replacing the red threaded/dust cover	10
19	Type and size of the threads of the "Ex-db" cable entries	10
20	Electrical data.....	11
21	Thermal data	13

Supplementary documentation:

- Operating Instructions VEGAPULS 61, 62, 63, 65, 66, 68, SR68
- Quick setup guide VEGAPULS 61, 62, 63, 65, 66, 68, SR68
- Certificate of Conformity CSA 1507580 (Document ID: 61884)

Editing status: 2019-07-04

1 Area of applicability

These safety instructions apply to the radar sensors:

- VEGAPULS PS61(*).KG***H/D/P/K/F/L/B/G/I/M/7/8****
- VEGAPULS PS62(*).KG***H/D/P/K/F/L/B/G/I/M/7/8****
- VEGAPULS PS63(*).KG***H/D/P/K/F/L/B/G/I/M/7/8****
- VEGAPULS PS65(*).KG***H/P/F/B/I/7****
- VEGAPULS PS66(*).KG***H/P/F/B/I/7****
- VEGAPULS PS68(*).KG***H/P/F/B/I/7****
- VEGAPULS PSSR68(*).KG***H/P/F/B/I/7****

With the electronics versions:

- H - Two-wire 4 ... 20 mA/HART
- D - Two-wire 4 ... 20 mA/HART with increased sensitivity
- P - Two-wire Profibus PA
- K - Two-wire Profibus PA with increased sensitivity
- F - Two-wire Foundation Fieldbus
- L - Two-wire Foundation Fieldbus with increased sensitivity
- B - Four-wire 4 ... 20 mA/HART; 90 ... 253 V AC, 50/60 Hz
- G - Four-wire 4 ... 20 mA/HART with increased sensitivity; 90 ... 253 V AC, 50/60 Hz
- I - Four-wire 4 ... 20 mA/HART; 9.6 ... 48 V DC, 20 ... 42 V AC
- M - Four-wire 4 ... 20 mA/HART with increased sensitivity; 9.6 ... 48 V DC, 20 ... 42 V AC
- 7 - Four-wire Modbus
- 8 - Four-wire Modbus with increased sensitivity

According to Certificate of Conformity CSA 1507580 (certificate number on the type label) and for all instruments with safety instruction 37780.

The classification as well as the respective standards are stated in the Certificate of Conformity.

- Class I, DIV 1, Groups A, B, C, D; Class II, DIV 1, Groups E, F, G; Class III
- Ex db ia IIC T6 ... T1 Ga/Gb, Gb

2 Important specification in the type code

VEGAPULS PS 61/62/63/65/66/68/SR68(*).abcd(e)fghij

Position		Feature	Description
a	Scope	K	CSA / Canada
b	Approval	G	Class I, DIV 1, Groups A, B, C, D; Class II, DIV 1, Groups E, F, G; Class III Ex db ia IIC T6...T1 Ga/Gb, Gb
c	Version / Material	*	One-digit alphanumeric variable for metal antenna, standpipe with different metal materials and diameters
d	Process fitting / Material	**	One or two-digit alphanumeric code for gas-tight threaded connections, pipe connections and industrial flanges acc. to ASME, BS, DIN, EN, GOST, HG/T, JIS, other international, national or industrial standards, regulations or standards with pressure specifications
(e)	Seal / Process temperature	*	One-digit alphanumeric variable for different seal materials, suitable for the application including the process temperature to be taken into account (Only for VEGAPULS 62, 66, 68, SR68)

Position		Feature	Description
f	Electronics	H	Two-wire 4 ... 20 mA/HART
		D	Two-wire 4 ... 20 mA/HART with increased sensitivity
		P	Two-wire Profibus PA
		K	Two-wire Profibus PA with increased sensitivity
		F	Two-wire Foundation Fieldbus
		L	Two-wire Foundation Fieldbus with increased sensitivity
		B	Four-wire 4 ... 20 mA/HART; 90 ... 253 V AC, 50/60 Hz
		G	Four-wire 4 ... 20 mA/HART with increased sensitivity; 90 ... 253 V AC, 50/60 Hz
		I	Four-wire 4 ... 20 mA/HART; 9.6 ... 48 V DC, 20 ... 42 V AC
		M	Four-wire 4 ... 20 mA/HART with increased sensitivity; 9.6 ... 48 V DC, 20 ... 42 V AC
		7	Four-wire Modbus
		8	Four-wire Modbus with increased sensitivity
i	Housing / Protection	D	Aluminium double chamber / IP 66/IP 68 (0.2 bar)
		S	Special colour Aluminium double chamber / IP 66/IP 68 (0.2 bar)
		W	Stainless steel double chamber / IP 66/IP 68 (0.2 bar)
h	Cabel entry	M	M20 x 1.5
		N	1½ NPT
		*	One-digit alphanumerical code for further suitable fittings, cable entries and closing screws.
i	Display and adjustment module PLICSCOM	X	without
		A	mounted
		F	without; lid with inspection window
		B	Laterally mounted
		K	mounted; with Bluetooth, magnetic pen operation
		L	laterally mounted; with Bluetooth, magnetic pen operation
j	Additional equipment	X	without
		*	with equipment

In the following, all above mentioned versions are called VEGAPULS 6*. If parts of these safety instructions refer only to certain versions, then these will be mentioned explicitly with their type code.

3 General information

The VEGAPULS 6* in ignition protection type intrinsic safety "i", "is", flameproof enclosure "d", "XP" are used for detection of the distance between product surface and sensor by means of high frequency, electromagnetic waves in the GHz range.

The electronics uses the running time of the signals reflected by the product surface to calculate the distance to the product surface.

The VEGAPULS 6* consist of an electronics housing, a process connection element and a sensor or an antenna.

The VEGAPULS 6* are suitable for applications in hazardous atmospheres of all combustible materials of explosion groups IIA, IIB and IIC.

The VEGAPULS 6* are suitable for applications requiring EPL Ga/Gb or EPL Gb instruments.

The VEGAPULS 6* are suitable for applications in hazardous atmospheres of all combustible materials of Class I Groups A, B, C, D, Class II Groups E, F, G and Class III.

The VEGAPULS 6* are suitable for applications requiring Division 1 or Division 2 instruments.





4 Application area

EPL Ga/Gb or division 1/2 instrument

The VEGAPULS 6* with mechanical fixing element are installed in hazardous areas of zone 1/DIV2. The mechanical fixing element, process connection element is installed in the separating wall, which separates areas requiring EPL Gb/DIV2 or EPL Ga/DIV1 instruments. The sensor measuring system is installed in hazardous areas of zone 0 requiring EPL Ga/DIV1 instruments.

EPL Gb or division 2 instrument

The VEGAPULS 6* with the mechanical fixing element are installed in hazardous areas of zone 1 requiring EPL Gb instruments.

VEGA Instrument	EPL Gb, DIV2	EPL Ga/Gb, DIV1/2
Ex Zone 1 or Division 2 		
Ex Zone 0 or Division 1 		

5 Specific conditions of use

The following overview is listing the specific conditions of use.

Electrostatic charging (ESD)

You can find the details in chapter "*Electrostatic charging (ESD)*" of these safety instructions.

Ambient temperature

The ambient temperature range can be limited.

You can find the details in chapter "*Thermal data*" of these safety instructions.

Impact and friction sparks

The VEGAPULS 6* in light metal versions (e.g. aluminium, titanium, zircon) must be mounted in such a way that sparks from impact and friction between light metals and steel (except stainless steel, if the presence of rust particles can be excluded) cannot occur.

Non-grounded, metallic parts

Resistance between aluminium housing to metal measurement loop labels is $> 10^9$ Ohm.

The capacitance of the metal measurement loop label was measured with 15 pF.

See chapter "*Electrostatic charging (ESD)*" for precaution.

6 Additional instructions for safe operation

- The 3/8" NPT threaded port of the Dual-Chamber housing shall not be used as a field wiring conduit entry and has to be closed at all times with a suitable plug.
- Components for installation and connection not included in the approval documents are only permitted if these correspond technically to the latest standard mentioned on the cover sheet. They must be suitable for the application conditions and have a separate certificate. The special conditions of the components must be noted and if necessary, the components must be integrated in the type test. This applies also to the components already mentioned in the technical description.
- The operator must ensure that the medium temperature in the EPL Ga range within the process vessel is not higher than 80 % of the self-ignition temperature of the concerned medium (in °C) and does not exceed the max. permissible flange temperature depending on the temperature class. The parts of the level measuring instrument which during operation are in contact with flammable products, must be integrated in the periodic overpressure test of the plant.
- If parts of the VEGAPULS 6* within the EPL Ga area are in contact with the medium and made of a material with an electrical conductivity of less than 10-8 S/m, a min. conductivity of the measured substance of at least 10-8 S/m must be ensured to avoid danger caused by electrostatic charge. If this is not possible, the level measuring instrument must not be used if there are strong charge-generating processes exist, such as e.g. automatic friction and separating processing, sparking electrons etc. Particularly the antenna of the level measuring instrument must not be mounted in the pneumatic flow rate.
- The VEGAPULS 6* must be installed in such a way that sensor (antenna) does not touch the vessel wall. Especially the inner tank structure, the flow conditions in the tank and the antenna length must be taken into account.
- The installation of the antenna of VEGAPULS 6* with EPL Ga must be only carried out with process pressures between 0.8 and 1.1 bar.
- For process pressures outside the standard atmospheric conditions of 80 kPa (0.8 bar) to 110 kPa (1.1 bar) additional requirements can be valid.
- In the constructive version of the rinsing connection it must be ensured that when using in the EPL Ga/Gb area, protection IP 67 is ensured at the connection to the reflux valve. After removal of the reflux valve, the opening must be closed with a suitable plug screw in order to maintain protection IP 67.
- In the version with ball valve it must be ensured that before separating the flange connection, the valve must be closed.
- For level measuring instruments in the version with swivelling holder keep in mind that when operating as EPL Ga/Gb instruments after the antenna has been aligned (by means of the swivelling holder) and the mounting flange screwed on, protection rating IP 67 is maintained.

Connection conditions

- Unused openings must be covered. The red thread or/dust covers screwed in when the instruments are shipped (depending on the version) must be removed before setup and replaced by cable entries or closing screws suitable for the respective ignition protection type and IP protection.
- The connection cable of VEGAPULS 6* has to be wired fix and in such a way that damages can be excluded
- If the temperature at the inlet components exceeds 60 °C, temperature-resistant connection cables must be used
- The VEGAPULS 6* must be integrated in the local potential equalization of the hazardous areas (contact resistor $\leq 1 \text{ M}\Omega$)
- Use the instrument only in media against which the wetted parts are sufficiently resistant
- If necessary, a suitable overvoltage arrester can be connected in front of the VEGAPULS 6*

7 Important information for mounting and maintenance

General instructions

The following requirements must be fulfilled for mounting, electrical installation, setup and maintenance of the instrument:

- The staff must be qualified according the respective tasks
- The staff must be trained in explosion protection
- The staff must be familiar with the respectively valid regulations, e.g. planning and installation acc. to CEC or NEC
- Make sure when working on the instrument (mounting, installation, maintenance) that there is no explosive atmosphere present, the supply circuits should be voltage-free, if possible.
- The instrument has to be mounted according to the manufacturer specifications, the approval certificate and the valid regulations and standards
- Modifications on the instrument can influence the explosion protection and hence the safety
- Modifications must only be carried out by employees authorized by VEGA company

Mounting

Keep in mind for instrument mounting

- Mechanical damage on the instrument must be avoided
- Mechanical friction must be avoided
- Process connections separating two areas of different Ex-zones must comply to valid regulations and standards
- Close the housing lid (s) up to the stop before starting operating, to ensure the IP protection rating specified on the type label

Maintenance

To ensure the functionality of the device, periodic visual inspection is recommended for:

- Secure mounting
- No mechanical damages or corrosion
- Worn or otherwise damaged cables
- The potential equalization terminal must be secured against loosening
- Correct and clearly marked cable connections

The parts of the VEGAPULS 6* being in contact with flammable media during operation must be included in the periodic overpressure test of the plant.

8 Potential equalization/Grounding

- Integrate the instruments into the local potential equalisation, e.g. via the internal or external earth terminal
- The potential equalization terminal must be secured against loosening and twisting
- If grounding of the cable screening is necessary, this must be carried out acc. to the valid standards and regulations

9 Electrostatic charging (ESD)

In case of instrument versions with electrostatically chargeable plastic parts, the danger of electrostatic charging and discharging must be taken into account!

The following parts can charge and discharge:

- Lacquered housing version
- Metal housing with inspection window
- Plastic process fittings

- Plastic-coated process fittings and/or plastic-coated sensors
- Connection cable for separate versions
- Type label
- Isolated metallic labels (measurement loop identification label)

Take note in case of danger of electrostatic charges:

- Avoid friction on the surfaces
- Do not dry clean the surfaces

The instruments must be mounted/installed in such a way that the following can be ruled out:

- electrostatic charges during operation, maintenance and cleaning.
- process-related electrostatic charges, e.g. by measuring media flowing past

The warning label indicates danger:

WARNING -- POTENTIAL ELECTROSTATIC CHARGING
HAZARD -- SEE INSTRUCTIONS

AVERTISSEMENT -- DANGER POTENTIEL DE CHARGES
ÉLECTROSTATIQUES -- VOIR INSTRUCTIONS

10 Type of protection flameproof enclosure Ex "db", "XP"

The terminals for connecting the operating voltage or signal circuits are integrated in the connection compartment with type of protection flameproof enclosure "db".

The thread gaps between housing and cover as well as between threaded fitting and container are flameproof joints.

The "Ex-db" connection compartment is provided with a M20 x 1.5 or ½-14 NPT thread for connection to a certified "Conduit" system or for mounting a "Ex-db" cable entry certified according to IEC 60079-1. Cable entries of simple construction may not be used. Please take note of section 13.1 and 13.2 of IEC 60079-1. When connecting to a "Conduit" system, the associated sealing facility must be located directly on the "Ex-db" connection compartment.

A certified "Ex-d" cable gland can optionally be supplied with the delivery. It is suitable for insertion of armoured or unarmoured cables depending on the ordered version. The instructions in the document accompanying the respective cable entry must be observed. The "Ex-db" cable entry must be screwed tightly into the housing. The supplied cable entry is suitable for the housing temperature range mentioned in the VEGAPULS 6* specification. If a different cable entry is used, the separately certified cable entry or the temperature classes on the electronics determines the maximum permissible ambient temperature on the housing.

Before opening the lid of the "Ex-db" terminal compartment or in case it is already open (e. g. during connection or service work), make sure that either the supply cable is completely voltage free or no explosive atmosphere is present.

When wiring the connection line to the "Ex-db" connection compartment, it must be sufficiently secured against damage and in conformity with IEC 60079-14.

The connection cables, the cable entries and the plugs or the pipeline sealing facilities must be suitable for the application conditions (e.g. temperature range).

The cover of the "Ex-db" connection compartment must be screwed in completely before commissioning and secured by screwing out the lid locking screw all the way to the stop.

Unused openings must be sealed according to IEC 60079-1 paragraph 11.9.

The flame path joints must not be repaired.

Double chamber housing with "Ex-db" connection compartment



- 1 "Ex-i" connection compartment with electronics module
- 2 Locking screw of the lid
- 3 "Ex db" connection compartment with integrated barrier
- 4 Screw plug

The cover of the "Ex-db" connection compartment with the caution label "Do not open when an explosive atmosphere is present" and the cover of the "Ex-i" connection compartment without caution label must not be exchanged. The covers must be mounted on the corresponding connection compartments.

11 Versions with antenna extension

The VEGAPULS 6* with antenna extension have to be mounted so that the extension is effectively secured against bending or oscillating as well as contact of the sensor to the vessel wall, under consideration of the vessel installations and flow conditions in the vessel.

12 Versions with ball valve

With the VEGAPULS 6* in the version with ball valve, make sure that the ball valve is closed before separating the flange connection and that the IP rating IP 67 is maintained when removing the instrument.

13 Impact and friction sparks

The VEGAPULS 6* in Aluminium/Titanium version must be mounted in such a way that sparks from impact and friction between Aluminium/Titanium and steel (except stainless steel, if the presence of rust particles can be excluded) cannot occur.

14 Material resistance

For applications requiring instruments of type EPL Ga or EPL Ga/Gb the VEGAPULS 6* must only be used in products against which the wetted materials are sufficiently resistant.

15 Installation with swivelling holder

VEGAPULS 6* as EPL Ga/Gb instrument in the version with swivelling holder must be installed in such a way that, after the antenna has been aligned (by means of the swivelling holder) and the mounting flange screwed on, protection rating IP 67 is maintained.

16 Versions with rinsing connection

With VEGAPULS 6* as EPL Ga/Gb instrument in the version with rinsing connection, make sure the protection class IP 67 is ensured on the connection to the reflux valve.

After removal of the reflux valve or the rinsing air connection on the reflux valve, the opening has to be closed with an appropriate closing screw, so that protection class IP 67 is maintained. Please make sure that during rinsing processes in the antennas, i.e. when the sensor is cleaned, no hazardous atmosphere is present.

17 Mounting with external display unit VEGADIS 61/81


The intrinsically safe signal circuit between VEGAPULS 6* and the external indicating unit VEGADIS 61/81 should be set up without grounding. The required insulation voltage is > 500 V AC. When using the VEGA connection cable included with the delivery, this requirement is fulfilled. If grounding of the cable screen is required, it must be carried out according to IEC 60079-14.

18 Removing and replacing the red threaded/dust cover

When the VEGAPULS 6* are delivered, depending on the version, the red threaded or dust protection caps must be removed before installing the device and the openings must be sealed according to the requirements of the type of protection and the IP protection type specified on the type label.

When using certified i.e. suitable cable glands, sealing plugs or plug connectors, they must be mounted correctly and the respective certificates/documents must be observed.

The sealing plugs included in the delivery by VEGA meet the necessary requirements.

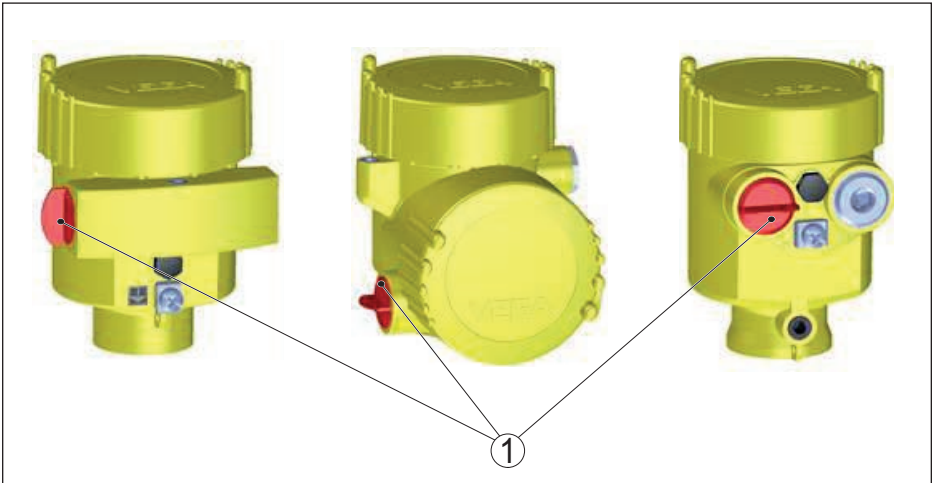

1 Red threaded or dust protection cap

19 Type and size of the threads of the "Ex-db" cable entries

The "Ex-db" connection compartment of the VEGAPULS P*.KG***(*)**M** has cable entries M20 x 1.5.

The "Ex-db" connection compartment of the VEGAPULS P*.KG***(*)**N** has cable entries ½-14 NPT.

20 Electrical data

The electrical data listed in the following are valid for:

Non-intrinsically safe circuits

VEGAPULS PS61/62/63/65/66/68/SR68(*).KG**(*)B/G/I/M***** (electronics 4 ... 20 mA/HART - four-wire)

Supply and signal circuit:	
Terminals 1[+], 2[-] in "Ex db" connection compartment	U = 9,6 ... 48 V DC (M/I) U = 20 ... 42 V AC (M/I) U = 90 ... 250 V AC (G/B) Um = 253 V
Active signal circuit: (terminals 5[+], 7[-] in the "Ex db" connection compartment)	Iout = 4 ... 20 mA with superimposed HART signal Um = 60 V
Passive signal circuit: (terminals 6[+], 7[-] in the "Ex db" connection compartment)	Iin = 4 ... 20 mA with superimposed HART signal Um = 60 V

VEGAPULS PS61/62/63/65/66/68/SR68(*).KG**(*)H/D**** (electronics 4 ... 20 mA/HART - two-wire)

Supply and signal circuit:	
Terminals 1[+], 2[-] in "Ex db" connection compartment	U = 14 ... 36 V DC Um = 253 V

VEGAPULS PS61/62/63/65/66/68/SR68(*).KG**(*)P/F/K/L**** (electronics Profibus PA, Foundation Fieldbus)

Supply and signal circuit:	
Terminals 1[+], 2[-] in "Ex db" connection compartment	U = 14 ... 32 V DC Um = 253 V

VEGAPULS PS61/62/63/65/66/68/SR68(*).KG**(*)7/8***** (electronics Modbus)

Supply circuit:	
Terminals 1[+], 2[-] in "Ex db" connection compartment	U = 8 ... 30 V DC
Modbus signal:	
Terminals 3[D0+], 4[D1-]	U _{max} = 5 V with Modbus signal (telegram)
Terminals 5[IS GND]	Function ground when installing according to CSA (Canadian Standards Association)
USB connection:	
6-pole mini USB socket "Ex db" in connection compartment	U _{max} with USB signal (USB protocol)

Intrinsically safe circuits

The connection of these intrinsically safe circuits is carried out on terminals, which are located in an

"Ex i" connection compartment.

VEGAPULS PS61/62/63/65/66/68/SR68(*).KG(*)B/G/I/M/7/8**** (electronics 4 ... 20 mA/HART - four-wire, Modbus)**

Display and adjustment circuit:	
Spring contacts in the "Ex i" electronics compartment	<p>Type of protection intrinsic safety Ex ia IIC</p> <p>Only for connection to the display and adjustment module PLICSCOM or for connection to the intrinsically safe supply and signal circuit of the corresponding external indicating unit VEGADIS 61/81 via the VEGADIS-ADAPT.</p> <p>The rules for the interconnection of intrinsically safe circuits between VEGAPULS 6* and the external indicating unit VEGADIS 61/81 are fulfilled, provided that the total inductance and total capacitance of the connection cable between VEGAPULS 6* and the external indicating unit VEGADIS 61/81 $L_{\text{cable}} = 310 \mu\text{H}$ and $C_{\text{cable}} = 2 \mu\text{F}$ are not exceeded.</p> <p>When using the delivered VEGA connection cable between VEGAPULS 6* and the external indicating unit VEGADIS 61/81, the following listed cable inductances L_i and cable capacitances C_i must be taken into account with a cable length $\geq 50 \text{ m}$.</p> <ul style="list-style-type: none"> ● $L_i = 0.62 \mu\text{H/m}$ ● $C_{i \text{ wire/wire}} = 132 \text{ pF/m}$ ● $C_{i \text{ wire/screen}} = 208 \text{ pF/m}$ ● $C_{i \text{ screen/screen}} = 192 \text{ pF/m}$

The intrinsically safe circuits of VEGAPULS PS6*(*)/PSSR68(*).KG**(*)B/G/I/M**** are earthed and connected to the external and internal earth terminal.

VEGAPULS PS61/62/63/65/66/68/SR68(*).KG**(*)H/D/P/K/F/L/7/8**** (electronics 4 ... 20 mA/HART - two-wire, Profibus PA, Foundation Fieldbus, Modbus)

Display and adjustment circuit:	
Terminals 5, 6, 7, 8 in "Ex i" electronics compartment	<p>Type of protection intrinsic safety Ex ia IIC</p> <p>For connection to the intrinsically safe circuit of the associated external indicating instrument VEGADIS 61/81.</p> <p>The rules for the interconnection of intrinsically safe circuits between VEGAPULS 6* and the external indicating unit VEGADIS 61/81 are fulfilled, provided that the total inductance and total capacitance of the connection cable between VEGAPULS 6* and the external indicating unit VEGADIS 61/81 $L_{\text{cable}} = 310 \mu\text{H}$ and $C_{\text{cable}} = 2 \mu\text{F}$ are not exceeded.</p> <p>When using the delivered VEGA connection cable between VEGAPULS 6* and the external indicating unit VEGADIS 61/81, the following listed cable inductances L_c and cable capacitances C_c must be taken into account with a cable length $\geq 50 \text{ m}$.</p> <ul style="list-style-type: none"> ● $L_c = 0.62 \mu\text{H/m}$ ● $C_{\text{wire/wire}} = 132 \text{ pF/m}$ ● $C_{\text{wire/screen}} = 208 \text{ pF/m}$ ● $C_{\text{screen/screen}} = 192 \text{ pF/m}$

VEGAPULS PS61/62/63/65/66/68/SR68(*).KG**(*)H/D/P/K/F/L**** (electronics 4 ... 20 mA/HART - two-wire, Profibus PA, Foundation Fieldbus)

Intrinsically safe circuit of the display and adjustment module:	
Spring contacts in electronics compartment of the single chamber housing or Spring contacts in electronics compartment of the double chamber housing	<p>In ignition protection type intrinsic safety Ex ia IIC</p> <p>Only for connection to the corresponding display and adjustment module PLICSCOM</p>

The intrinsically safe circuits of VEGAPULS PS6*(*).PSSR68(*).KG**(*)H/D/P/K/F/L**** are potential free and reliably galvanically separated from the non-intrinsically safe circuit up to a peak value of the voltage of 375 V.

The metallic parts of the VEGAPULS PS6*(*).SR68(*).KG**** are electrically connected to the earth terminals.

21 Thermal data

The permissible operating temperatures without explosion-endangered atmosphere are mentioned in the respective manufacturer instructions, e.g. operating instructions manuals.

The division of the temperature classes of the different VEGAPULS 6* versions is specified in form of tables.

Furthermore it must be observed that the tables for instruments with a permissible process temperature of up to +195 °C with an isolation (heat conductance of 0.05 W/(m²K) with 2 cm thick insulation) were determined. Two layers of insulation material with a thickness of 2 cm each were attached from the tank surface with the mentioned heat conductance.

Instruments for process temperatures of max. +80 °C or +130 °C were not isolated for determination

of the tables.

VEGAPULS PS61(*).KG***H/D/B/G/I/M****

Temperature class	Process Temperature at the sensor in Zn 0 (EPL Ga)	Ambient temperature at the electronic in Zn 0 (EPL Gb)
T6	-20 ... +60 °C	-40 ... +46 °C
T5, T4, T3, T2, T1	-20 ... +60 °C	-40 ... +60 °C

Temperature class	Process Temperature at the sensor in Zn 0 (EPL Gb) or in Cl I, Div 1	Ambient temperature at the electronic in Zn 1 (EPL Gb) or in Cl I, Div 1
T6	-60 ... +80 °C	-40 ... +46 °C
T5, T4, T3, T2, T1	-60 ... +80 °C	-40 ... +60 °C

VEGAPULS PS61(*).KG***P/F/K/L/7/8****

Temperature class	Process Temperature at the sensor in Zn 0 (EPL Ga)	Ambient temperature at the electronic in Zn 1 (EPL Gb)
T6	-20 ... +60 °C	-40 ... +46 °C
T5, T4, T3, T2, T1	-20 ... +60 °C	-40 ... +60 °C

Temperature class	Process Temperature at the sensor in Zn 0 (EPL Gb) or in Cl I, Div 1	Ambient temperature at the electronic in Zn 0 (EPL Gb) or in Cl I, Div 1
T6	-60 ... +80 °C	-40 ... +46 °C
T5, T4, T3, T2, T1	-60 ... +80 °C	-40 ... +60 °C

VEGAPULS PS62(*).KG****H/D/B/G/I/M****

Temperature class	Process Temperature at the sensor in Zn 0 (EPL Ga)	Ambient temperature at the electronic in Zn 1 (EPL Gb)
T6	-20 ... +60 °C	-40 ... +46 °C
T5, T4, T3, T2, T1	-20 ... +60 °C	-40 ... +60 °C

Temperature class	Process Temperature at the sensor in Zn 0 (EPL Gb) or in Cl I, Div 1	Ambient temperature at the electronic in Zn 0 (EPL Gb) or in Cl I, Div 1
T6	-60 ... +80 °C	-40 ... +46 °C
T5	-60 ... +95 °C	-40 ... +60 °C
T4	-60 ... +130 °C	-40 ... +60 °C
T3	-60 ... +195 °C	-40 ... +60 °C
T2	-60 ... +290 °C	-40 ... +60 °C
T1	-60 ... +440 °C	-40 ... +60 °C

-170 °C version - VEGAPULS PS62(*).KG****H/D/B/G/I/M****

Temperature class	Process Temperature at the sensor in Zn 0 (EPL Ga) or in Cl I, Div 1	Ambient temperature at the electronic in Zn 0 (EPL Ga) or in Cl I, Div 1
T6	-170 ... +80 °C	-40 ... +46 °C
T5	-170 ... +95 °C	-40 ... +60 °C
T4	-170 ... +130 °C	-40 ... +60 °C
T3	-170 ... +195 °C	-40 ... +60 °C
T2	-170 ... +290 °C	-40 ... +60 °C
T1	-170 ... +440 °C	-40 ... +60 °C

VEGAPULS PS62(*).KG****P/F/K/L/7/8****

Temperature class	Process Temperature at the sensor in Zn 0 (EPL Ga)	Ambient temperature at the electronic in Zn 1 (EPL Gb)
T6	-20 ... +60 °C	-40 ... +46 °C
T5, T4, T3, T2, T1	-20 ... +60 °C	-40 ... +60 °C

Temperature class	Process Temperature at the sensor in Zn 0 (EPL Gb) or in Cl I, Div 1	Ambient temperature at the electronic in Zn 0 (EPL Gb) or in Cl I, Div 1
T6	-60 ... +80 °C	-40 ... +46 °C
T5	-60 ... +95 °C	-40 ... +60 °C
T4	-60 ... +130 °C	-40 ... +60 °C
T3	-60 ... +195 °C	-40 ... +60 °C
T2	-60 ... +290 °C	-40 ... +60 °C
T1	-60 ... +440 °C	-40 ... +60 °C

-170 °C version - VEGAPULS PS62(*).KG****P/F/K/L/7/8****

Temperature class	Process Temperature at the sensor in Zn 0 (EPL Ga) or in Cl I, Div 1	Ambient temperature at the electronic in Zn 0 (EPL Ga) or in Cl I, Div 1
T6	-170 ... +80 °C	-40 ... +46 °C
T5	-170 ... +95 °C	-40 ... +60 °C
T4	-170 ... +130 °C	-40 ... +60 °C
T3	-170 ... +195 °C	-40 ... +60 °C
T2	-170 ... +290 °C	-40 ... +60 °C
T1	-170 ... +440 °C	-40 ... +60 °C

VEGAPULS PS63(*).KG***H/D/B/G/I/M****

Temperature class	Process Temperature at the sensor in Zn 0 (EPL Ga)	Ambient temperature at the electronic in Zn 1 (EPL Gb)
T6	-20 ... +60 °C	-40 ... +46 °C

Temperature class	Process Temperature at the sensor in Zn 0 (EPL Ga)	Ambient temperature at the electronic in Zn 1 (EPL Gb)
T5, T4, T3, T2, T1	-20 ... +60 °C	-40 ... +60 °C

Temperature class	Process Temperature at the sensor in Zn 0 (EPL Gb) or in Cl I, Div 1	Ambient temperature at the electronic in Zn 0 (EPL Gb) or in Cl I, Div 1
T6	-60 ... +80 °C	-40 ... +46 °C
T5	-60 ... +95 °C	-40 ... +60 °C
T4	-60 ... +130 °C	-40 ... +60 °C
T3	-60 ... +195 °C	-40 ... +60 °C
T2, T1	-60 ... +200 °C	-40 ... +60 °C

-170 °C version - VEGAPULS PS63(*).KG*H/D/B/G/I/M*****

Temperature class	Process Temperature at the sensor in Zn 0 (EPL Ga) or in Cl I, Div 1	Ambient temperature at the electronic in Zn 0 (EPL Ga) or in Cl I, Div 1
T6	-170 ... +80 °C	-40 ... +46 °C
T5	-170 ... +95 °C	-40 ... +60 °C
T4	-170 ... +130 °C	-40 ... +60 °C
T3	-170 ... +195 °C	-40 ... +60 °C
T2, T1	-170 ... +200 °C	-40 ... +60 °C

VEGAPULS PS63(*).KG*P/F/K/L/7/8******

Temperature class	Process Temperature at the sensor in Zn 0 (EPL Ga)	Ambient temperature at the electronic in Zn 1 (EPL Gb)
T6	-20 ... +60 °C	-40 ... +46 °C
T5, T4, T3, T2, T1	-20 ... +60 °C	-40 ... +60 °C

Temperature class	Process Temperature at the sensor in Zn 0 (EPL Gb) or in Cl I, Div 1	Ambient temperature at the electronic in Zn 0 (EPL Gb) or in Cl I, Div 1
T6	-60 ... +80 °C	-40 ... +46 °C
T5	-60 ... +95 °C	-40 ... +60 °C
T4	-60 ... +130 °C	-40 ... +60 °C
T3	-60 ... +195 °C	-40 ... +60 °C
T2, T1	-60 ... +200 °C	-40 ... +60 °C

-170 °C version - VEGAPULS PS63(*).KG*P/F/K/L/7/8******

Temperature class	Process Temperature at the sensor in Zn 0 (EPL Ga) or in Cl I, Div 1	Ambient temperature at the electronic in Zn 0 (EPL Ga) or in Cl I, Div 1
T6	-170 ... +80 °C	-40 ... +46 °C

Temperature class	Process Temperature at the sensor in Zn 0 (EPL Ga) or in Cl I, Div 1	Ambient temperature at the electronic in Zn 0 (EPL Ga) or in Cl I, Div 1
T5	-170 ... +95 °C	-40 ... +60 °C
T4	-170 ... +130 °C	-40 ... +60 °C
T3	-170 ... +195 °C	-40 ... +60 °C
T2, T1	-170 ... +200 °C	-40 ... +60 °C

VEGAPULS PS65(*).KG***H/B/I****

Temperature class	Process Temperature at the sensor in Zn 0 (EPL Ga)	Ambient temperature at the electronic in Zn 1 (EPL Gb)
T6	-20 ... +60 °C	-40 ... +46 °C
T5, T4, T3, T2, T1	-20 ... +60 °C	-40 ... +60 °C

Temperature class	Process Temperature at the sensor in Zn 0 (EPL Gb) or in Cl I, Div 1	Ambient temperature at the electronic in Zn 0 (EPL Gb) or in Cl I, Div 1
T6	-60 ... +80 °C	-40 ... +46 °C
T5	-60 ... +95 °C	-40 ... +60 °C
T4	-60 ... +130 °C	-40 ... +60 °C
T3, T2, T1	-60 ... +150 °C	-40 ... +60 °C

VEGAPULS PS65(*).KG***P/F/7****

Temperature class	Process Temperature at the sensor in Zn 0 (EPL Ga)	Ambient temperature at the electronic in Zn 1 (EPL Gb)
T6	-20 ... +60 °C	-40 ... +46 °C
T5, T4, T3, T2, T1	-20 ... +60 °C	-40 ... +60 °C

Temperature class	Process Temperature at the sensor in Zn 0 (EPL Gb) or in Cl I, Div 1	Ambient temperature at the electronic in Zn 0 (EPL Gb) or in Cl I, Div 1
T6	-60 ... +80 °C	-40 ... +46 °C
T5	-60 ... +95 °C	-40 ... +60 °C
T4	-60 ... +130 °C	-40 ... +60 °C
T3, T2, T1	-60 ... +150 °C	-40 ... +60 °C

VEGAPULS PS66(*).KG****H/B/I****

Temperature class	Process Temperature at the sensor in Zn 0 (EPL Ga)	Ambient temperature at the electronic in Zn 1 (EPL Gb)
T6	-20 ... +60 °C	-40 ... +46 °C
T5, T4, T3, T2, T1	-20 ... +60 °C	-40 ... +60 °C

Temperature class	Process Temperature at the sensor in Zn 0 (EPL Gb) or in Cl I, Div 1	Ambient temperature at the electronic in Zn 0 (EPL Gb) or in Cl I, Div 1
T6	-60 ... +80 °C	-40 ... +46 °C
T5	-60 ... +95 °C	-40 ... +60 °C
T4	-60 ... +130 °C	-40 ... +60 °C
T3	-60 ... +195 °C	-40 ... +60 °C
T2	-60 ... +290 °C	-40 ... +60 °C
T1	-60 ... +400 °C	-40 ... +60 °C

VEGAPULS PS66(*).KG**P/F/7******

Temperature class	Process Temperature at the sensor in Zn 0 (EPL Ga)	Ambient temperature at the electronic in Zn 1 (EPL Gb)
T6	-20 ... +60 °C	-40 ... +46 °C
T5, T4, T3, T2, T1	-20 ... +60 °C	-40 ... +60 °C

Temperature class	Process Temperature at the sensor in Zn 0 (EPL Gb) or in Cl I, Div 1	Ambient temperature at the electronic in Zn 0 (EPL Gb) or in Cl I, Div 1
T6	-60 ... +80 °C	-40 ... +46 °C
T5	-60 ... +95 °C	-40 ... +60 °C
T4	-60 ... +130 °C	-40 ... +60 °C
T3	-60 ... +195 °C	-40 ... +60 °C
T2	-60 ... +290 °C	-40 ... +60 °C
T1	-60 ... +400 °C	-40 ... +60 °C

VEGAPULS PS68/PSSR68(*).KG**H/B/I******


Temperature class	Process Temperature at the sensor in Zn 0 (EPL Ga)	Ambient temperature at the electronic in Zn 1 (EPL Gb)
T6	-20 ... +60 °C	-40 ... +46 °C
T5, T4, T3, T2, T1	-20 ... +60 °C	-40 ... +60 °C

Temperature class	Process Temperature at the sensor in Zn 0 (EPL Gb) or in Cl I, Div 1		Ambient temperature at the electronic in Zn 0 (EPL Gb) or in Cl I, Div 1
	VEGAPULS PS68	VEGAPULS PSSR68	
T6	-60 ... +80 °C		-40 ... +46 °C
T5	-60 ... +95 °C		-40 ... +60 °C
T4	-60 ... +130 °C		-40 ... +60 °C
T3	-60 ... +195 °C		-40 ... +60 °C
T2	-60 ... +290 °C	-60 ... +250 °C	-40 ... +60 °C
T1	-60 ... +440 °C	-60 ... +250 °C	-40 ... +60 °C

VEGAPULS PS68/PSSR68(*).KG****P/F/7****

Temperature class	Process Temperature at the sensor in Zn 0 (EPL Ga)	Ambient temperature at the electronic in Zn 1 (EPL Gb)
T6	-20 ... +60 °C	-40 ... +46 °C
T5, T4, T3, T2, T1	-20 ... +60 °C	-40 ... +60 °C

Temperature class	Process Temperature at the sensor in Zn 0 (EPL Gb) or in Cl I, Div 1		Ambient temperature at the electronic in Zn 0 (EPL Gb) or in Cl I, Div 1
	VEGAPULS PS68	VEGAPULS PSSR68	
T6	-60 ... +80 °C		-40 ... +46 °C
T5	-60 ... +95 °C		-40 ... +60 °C
T4	-60 ... +130 °C		-40 ... +60 °C
T3	-60 ... +195 °C		-40 ... +60 °C
T2	-60 ... +290 °C	-60 ... +250 °C	-40 ... +60 °C
T1	-60 ... +440 °C	-60 ... +250 °C	-40 ... +60 °C

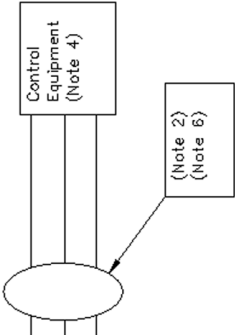Hazardous (Classified) Location		Unclassified Location	
Class I, Division 1 and 2, Groups A, B, C, and D Class II, Division 1, Groups E, F, and G Class III, Division 2, Groups F, and G (Note 3)			
<p>VEGAPULS 61 CABLE*</p> <p>(Note 2) Comm Port Input + (Note 5) Pin 1, 2 (Note 6) Pin 3 (Note 7) Pin 4</p> <p>* Connection cable between VEGADIS 61 and VEGAPULS Series 61. C cable $\leq 2\mu\text{F}$ L cable $\leq 310\mu\text{H}$ C cable $\leq 2\mu\text{F}$ These requirements are fulfilled when using the delivered VEGA connection cable with a length $\leq 50\text{m}$</p>		 <p>(Note 2) (Note 6)</p>	
<p>Notes:</p> <ol style="list-style-type: none"> The Intrinsic Safety Entity concept allows the interconnection of two intrinsically safe devices FM Approved and CSA Certified entity parameters not specifically examined in combination as a system when: U_0 or V_{oc} or $V_{t} \leq V_{max}$, I_0 or I_{sc} or $I_{t} \leq I_{max}$, C_0 or $C_1 \leq C_{lim}$, L_0 or $L_1 \leq L_{lim}$, $P_0 \leq P_{lim}$. For Division 2 installations, the Sensor shall be installed in accordance with the National Electrical Code® (ANSI/NFPA 70) or Canadian Electrical Code, CSA C22.1 Part 1 Appendix F for division 2 wiring methods. Dust-tight conduit seal shall be used when installed in Class II and Class III environments. For Division 1 installations, Control equipment shall not use or generate more than 250 Vrms or Vdc. Division 1 installations should be in accordance with ANSI/ISA RP12.06.01 "Installation of Intrinsically Safe Systems for Hazardous (Classified) Locations," and the National Electrical Code® (ANSI/NFPA 70) or Canadian Electrical Code. For Division 1 installations, the terminal marked (+) shall be grounded per ANSI/NFPA 70 article 504.50 or CSA C22.1 Part 1 Appendix F F3.2.2 and the Field Device shall be segregated from the supply wiring. For Division 2 installations, the Field Device shall be installed in accordance with the National Electrical Code® (ANSI/NFPA 70) or Canadian Electrical Code, CSA C22.1 Part 1 Appendix F for Division 2 wiring methods including Nonincendive Field Wiring when using the parameters shown. For Division 1 installations the configuration of Field Device must be FM Approved/CSA Certified under Entity Concept. The Field Device manufacturer's installation drawing shall be followed when installing this equipment. No revision to drawing without prior approval by FM Approvals and CSA International. No revision to drawing without prior approval by FM Approvals and CSA International. Warning—Substitution of components may impair suitability for hazardous locations. 		<p>CHART 87/M NUMBER VE206068</p> <p>CHART NUMBER GE2726</p> <p>OHMART VEGA 4241 Alameda Drive Cincinnati, Ohio 45209 USA</p> <p>INSTALLATION CONTROL DIAGRAM: VEGA SENSOR 6" * G DIV 1 FM/CSA EXD/ISA INSTRUMENTS</p> <p>THIS DOCUMENT INCLUDES INFORMATION WHICH IS PROPRIETARY TO OHMART VEGA. IT IS TO BE USED ONLY FOR THE PURPOSES OF THE ORDER FOR MANUFACTURING OR ANY OTHER PURPOSE EXCEPT AS AUTHORIZED BY OHMART VEGA. NO PART OF THIS DOCUMENT IS TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, WITHOUT PERMISSION IN WRITING FROM OHMART VEGA CORPORATION. THIS DOES NOT APPLY TO INFORMATION FURNISHED BY SHORTE OR OTHERS OUTSIDE OHMART VEGA CORPORATION.</p> <p>DATE 11/19/03 M.R. 11/19/03 B—GE2726</p> <p>MADE IN USA</p>	

Printing date:

VEGA

All statements concerning scope of delivery, application, practical use and operating conditions of the sensors and processing systems correspond to the information available at the time of printing.

Subject to change without prior notice

© VEGA Grieshaber KG, Schiltach/Germany 2019

37780-EN-190704

VEGA Grieshaber KG
Am Hohenstein 113
77761 Schiltach
Germany

Phone +49 7836 50-0
Fax +49 7836 50-201
E-mail: info.de@vega.com
www.vega.com